

Technical Information

Liquiline CM44P

Universal four-wire multichannel controller for process photometers and Memosens sensors



Field device or cabinet device

Application

- Food and beverages
- Life science
- Power stations
- Chemical industry
- Other industrial applications

Your benefits

- Highly flexible:
 - Able to connect up to 2 process photometers
 - Mathematics functions calculate new measured values
 - Digital fieldbuses (HART, PROFIBUS, Modbus, Ethernet/IP, PROFINET) and integrated web server
 - Choice of cleaning function, controller and alarm relay
 - Optional digital or analog inputs/outputs
- Maximum process safety thanks to standardized operating concept across all devices in the Liquiline, sampler and analyzer platform
- Fast commissioning thanks to:
 - Memosens: lab-calibrated sensors & hot plug-and-play
 - Preconfigured Liquiline transmitters
 - Easy extension and adaptation
- Minimum inventory:
 - Cross-platform, modular concept (e.g. identical modules irrespective of parameters)
 - Integration into FieldCare and W@M facilitates effective asset management

Table of contents

Function and system design	4	Current outputs, active	21
Measuring system with photometer	4	Span	21
Measuring system with optional Memosens sensors	5	Signal characteristic	21
Application example	6	Electrical specification	21
		Cable specification	21
Equipment architecture	7	Relay outputs	21
Slot and port assignment	7	Electrical specification	21
Order of the modules	7	Cable specification	22
Basic rule for hardware upgrades	8		
Determining the hardware delivery status	8	Protocol-specific data	22
Terminal diagram	8	HART	22
Device configuration using the example of a CM44P-**	10	PROFIBUS DP	23
Block circuit diagram of CM44P-**	11	Modbus RS485	23
		Modbus TCP	23
Communication and data processing	12	EtherNet/IP	23
		PROFINET	24
Dependability	12	Web server	25
Reliability	12		
Maintainability	14	Power supply	25
Security	17	Supply voltage	25
		Power consumption	25
Input	18	Fuse	25
Measured variables	18	Overvoltage protection	26
Measuring ranges	18	Cable entries (field device only)	26
Types of input	18	Cable specification	26
Input signal	18	Electrical connection	27
Cable specification	18	Connecting optional modules	28
		Protective ground connection	30
Digital inputs, passive	19	Sensor connection	30
Electrical specification	19		
Span	19	Performance characteristics	34
Nominal input current	19	Response time	34
PFM function	19	Reference temperature	34
Test voltage	19	Measured error for sensor inputs	34
Cable specification	19	Measured error for current inputs and outputs	34
		Frequency tolerance of digital inputs and outputs	34
Current input, passive	19	Resolution of current inputs and outputs	34
Span	19	Repeatability	34
Signal characteristic	19		
Internal resistance	19	Mounting	35
Test voltage	19	Mounting requirements	35
		Installation	36
Output	19	Mounting on DIN rail as per IEC 60715	37
Output signal	19	Wall mounting	38
Signal on alarm	20	Mounting the external display	39
Load	20		
Linearization/transmission behavior	20	Environment	39
		Ambient temperature	39
Digital outputs, passive	21	Storage temperature	39
Electrical specification	21	Relative humidity	39
External power supply	21	Degree of protection	39
PFM function	21	Climate class (cabinet device only)	40
Auxiliary voltage	21	Vibration resistance	40
Test voltage	21	Electromagnetic compatibility	40
Cable specification	21	Electrical safety	40
		Pollution degree	40

Pressure compensation to environment (field device only) . 40

Mechanical construction 41

Dimensions 41
 Weight 44
 Materials 45

Operability 45

display 45
 Operating concept 45
 Local operation 46
 Remote operation 46
 Language packages 48

Certificates and approvals 48

CE mark 48
 cCSAus 48
 Marine approvals 49
 ATEX / IECEx approval 49

Ordering information 50

Product page 50
 Product Configurator 50
 Scope of delivery 50

Accessories 50


Device-specific accessories 50
 Communication-specific accessories 56
 Service-specific accessories 57
 System components 58
 Other accessories 58

Function and system design

Measuring system with photometer

An optical measuring system comprises:

- Transmitter, e. g. Liquiline CM44P
- Sensor (photometer), e. g. OUSAF11/12/21/22/44/46, OUSTF10 or OUSBT66
- Cable set, e. g. CUK80
- The correct assembly for the sensor, e. g. OUA260
- The following are optional:
 - Post retainer
 - Protective cover
 - Memosens sensors (→ 5)

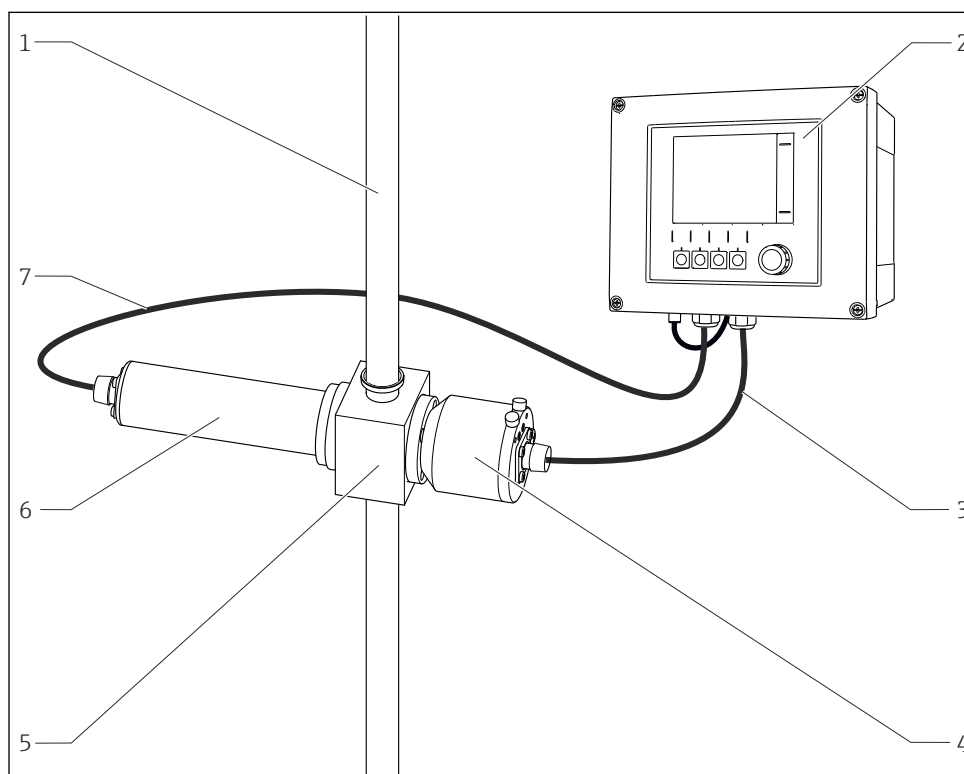

1 Example of a measuring system with a photometer sensor

- | | | | |
|---|-------------------|---|-----------------------------|
| 1 | Pipe | 5 | Flow assembly OUA260 |
| 2 | Transmitter CM44P | 6 | Sensor: light source (lamp) |
| 3 | CUK80 cable set | 7 | CUK80 cable set |
| 4 | Sensor: detector | | |

i You can combine your measuring point with a variety of Memosens sensors and suitable assemblies (→ 5). For more information, visit www.endress.com/cm44p

Measuring system with optional Memosens sensors

The overview shows examples of measuring systems. Other sensors and assemblies can be ordered for conditions specific to your application (www.endress.com/products).

Measuring point

A measuring system comprises:

- TransmitterLiquiline
- Optional display (for cabinet device)
- Sensors with Memosens technology
- Assemblies to suit the sensors used
- Post or rail mounting (optional, for field device)
- Weather protection cover (optional, for field device)


pH value or ORP

pH measurement in the pharmaceutical industry

- Retractable assembly Cleanfit CPA871
- Sensor Orbisint CPS11D
- Measuring cable CYK10

ORP in drinking water

- Dipfit CYA112 immersion assembly
- Sensor Orbisint CPS12D
- Measuring cable CYK10


**Conductivity**

Inductive conductivity measurement in the food industry

- Sensor Indumax CLS54D
- Sensor fixed cable


Conductive conductivity measurement in power plant cooling water

- Sensor Condumax CLS15D
- Measuring cable CYK10

**Oxygen**

Oxygen in aeration basins

- Dipfit CYA112 immersion assembly
- Holder CYH112
- Sensor
 - COS61D (optical) with fixed cable (→ Fig.)
 - COS51D (amperometric), cable CYK10


**Nitrate and SAC**

Nitrate in wastewater

- Sensor CAS51D-**A2 with fixed cable
- Dipfit CYA112 immersion assembly
- Holder CYH112

SAC in the wastewater treatment outlet

- Sensor CAS51D-**2C2 with fixed cable
- Dipfit CYA112 immersion assembly
- Holder CYH112


**Turbidity and interface**

Turbidity in industrial water

- Sensor Turbimax CUS51D with fixed cable (→ Fig.)
- Assembly Flowfit CUA250
- Spray head CUR3 (optional)


Interface in the primary clarifier

- Sensor Turbimax CUS71D
- Assembly CYA112
- Holder CYH112

**Disinfection**


Free available chlorine (and pH) in drinking water

- Sensor CCS142D
- Sensor CPS11D
- Measuring cable CYK10
- Flow assembly CCA250

**Ion-selective electrodes**

Ammonium and nitrate measurement in the aeration basin

- Sensor CAS40D with fixed cable
- Holder CYH112




If mounting outdoors, always use the weather protection cover (see "Accessories") to protect the transmitter against weather conditions.

Application example

Measuring point in chromatography monitoring

Transmitter CM44P-AADINP1M22A1FG15BAEA+PK (cabinet device) with:

- 1 photometer input, 2 Memosens inputs, PROFIBUS, 2 analog outputs and 2 digital inputs
- Optional display
- Photometer OUSAF44 (item 4)
- Flow assembly OUA260-AA1C05B1A3A with 2 mm path length and POPL, Triclamp 1/2", quartz window, item 3 (www.endress.com/oua260)
- Flow assembly CYA680 with 2x Pg 13.5 process connection for Memosens sensors, item 1
- pH and temperature with CPS71D, item 2 (www.endress.com/cps71d)
- Conductivity, conductive four-pin sensor CLS82D, item 5 (www.endress.com/cls82d)

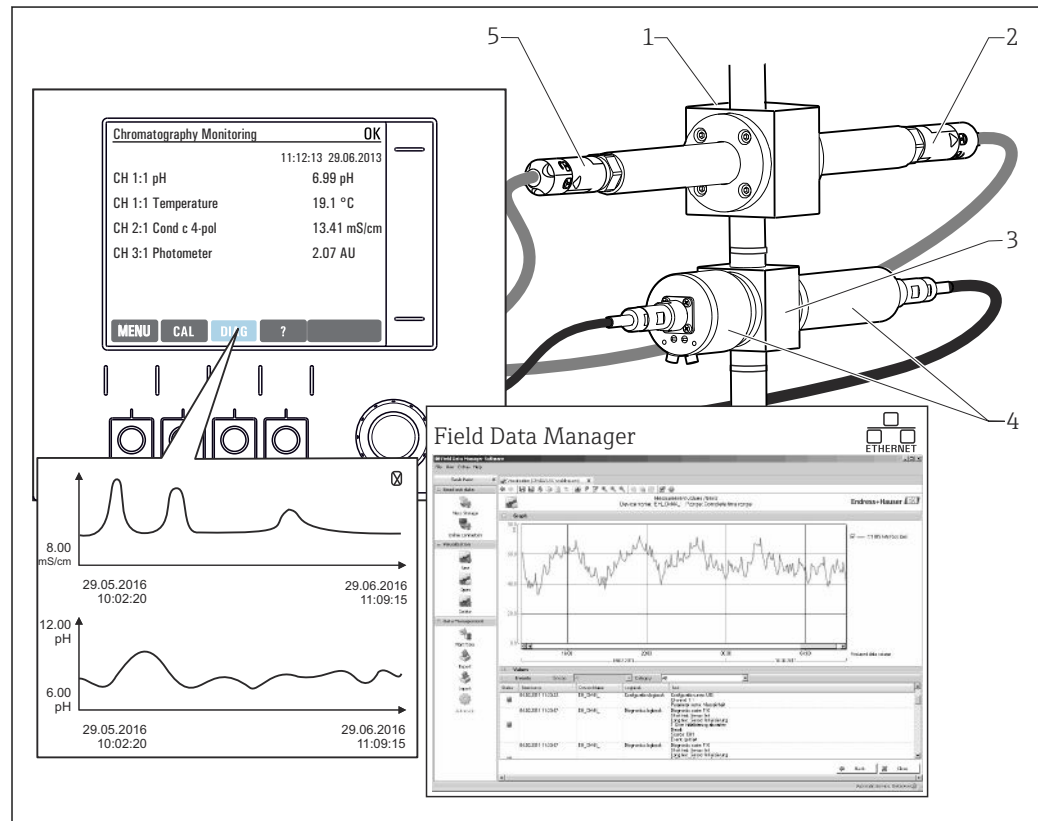

A0028707



2 Measuring point in chromatography monitoring

Data retention

- Storage of all measured values, incl. values of external sources, in the non-volatile memory (data logbook)
- Data called up on site via user-defined measuring menu and load curve display of the data logbook
- Transmission of data by ethernet, CDI interface or SD card and storage in a tamper-proof database (Field Data Manager)
- Data export to csv file (for Microsoft Excel)

Equipment architecture

Slot and port assignment

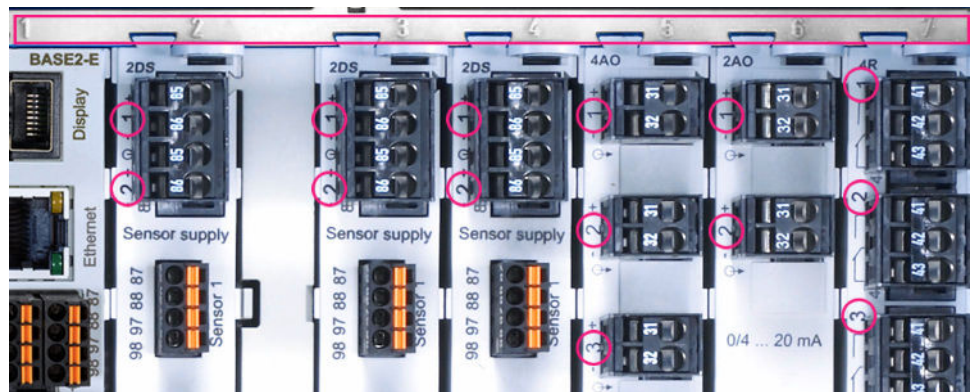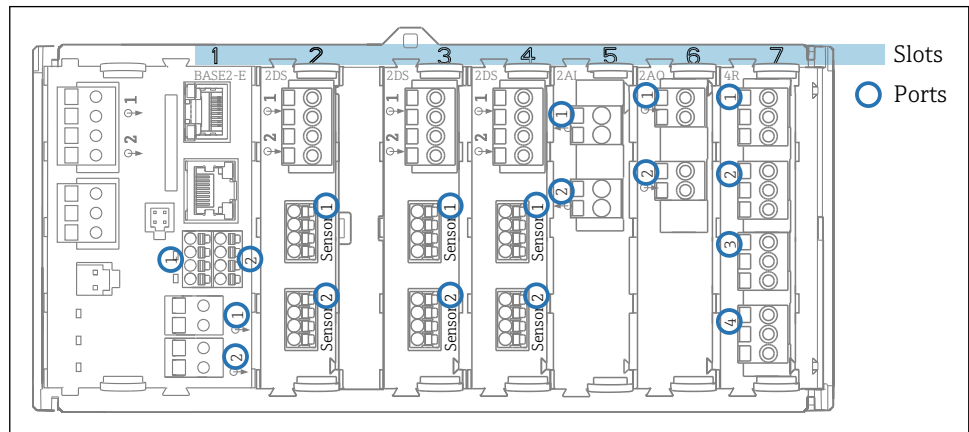

3 Slot and port assignment of the hardware modules

Outlet 1			OK
CH1:	1:1 pH Glass	ATC 6.95 pH	Port Slot
CH2:	1:2 TU/TS	500.0 g/l	
CH3:	5:1 SAC	500.0 1/m	
CH4:	5:2 Cond i	ATC 2.62 mS/cm	
CH5:	6:1 Chlorine	28.33 mg/l	
CH6:	6:2 Redox	± 51 mV	
CH7:	7:1 Oxygen (am...	32.86 mg/l	
CH8:	7:2 Cond c	ATC 131.1 µS/cm	
MENU CAL DIAG HOLD			

4 Slot and port assignment on the display

- Inputs are assigned to measuring channels in the ascending order of the slots and ports.
Adjacent example:
"CH1: 1:1 pH glass" means:
Channel 1 (CH1) is slot 1 (basic module) : Port 1 (input 1), pH glass sensor
- Outputs and relays are named according to their function, e.g. "current output", and are displayed in ascending order with the slot and port numbers

Order of the modules

Depending on the version ordered, the device is supplied with a number of electronic modules, which are assigned in a specific sequence in ascending order to slots 0 to 7. If you do not have a particular module, the next moves up automatically:

- The basic module (which is always present) always occupies slots 0 and 1
- Fieldbus module 485
- Photometer module PEM
- Memosens input module 2DS (DS = digital sensor)
- Extension module for digital inputs and outputs DIO (DIO = digital input and output)
- Current input module 2AI (AI = analog input)
- Current output modules 4AO or 2AO (AO = analog output)
- Relay modules AOR, 4R or 2R (AOR = analog output + relay, R = relay)

With intrinsically safe sensor communication module 2DS Ex-i:

- CM442/CM442R: always in slot 2
- CM444/CM444R: always in slot 7 (two channel) and slot 6 (four channel)
- CM448/CM448: slot 7, 6, 5

i Modules with 4 ports are connected before modules of the same type with 2 ports.

Basic rule for hardware upgrades



Please note the following if upgrading the device:

- The sum of all current inputs and outputs may not exceed 8!
- A maximum of two "DIO" modules may be used.

Determining the hardware delivery status

You must be aware of the type of modules and the number of them supplied with the device you have ordered to determine the delivery status of your Liquiline.

- **Basic module**
One basic module in all versions. Always occupies slots 0 and 1.
- **Fieldbus module**
Optional, and only one fieldbus module is possible.
- **Input modules**
 - Must be clearly assigned to the number of optional inputs ordered.
 - **Examples:**
2 current inputs = module 2AI
2 inputs for photometer sensors = module PEM
4 Memosens inputs = 2 inputs with basic module + module 2DS with 2 further inputs
- **Current outputs and relays**
Various module combinations can exist.
The following table will help you determine which modules your device has, depending on the type and number of outputs.

Current outputs	Relays		
	0	2	4
2	-	1 x 2R	1 x 4R
4	1 x 2AO	1 x AOR	1 x 2AO + 1 x 4R
6	1 x 4AO	1 x 4AO + 1 x 2R	1 x 4AO + 1 x 4R
8	1 x 4AO + 1 x 2AO	1 x 4AO + 1 x 2AO + 1 x 2R	1 x 4AO + 1 x 2AO + 1 x 4R

- Sum up the number of modules and sort them according to the specified sequence → 7.
↳ This will give you the slot assignment for your device.

Terminal diagram




The unique terminal name is derived from:

Slot no. : Port no. : Terminal

Example, NO contact of a relay

Device with 2 inputs for digital sensors, 4 current outputs and 4 relays


- Base module BASE2-E (contains 2 sensor inputs, 2 current outputs)
- PEM module (1 photometer sensor)
- 2AO module (2 current outputs)
- 4R module (4 relays)

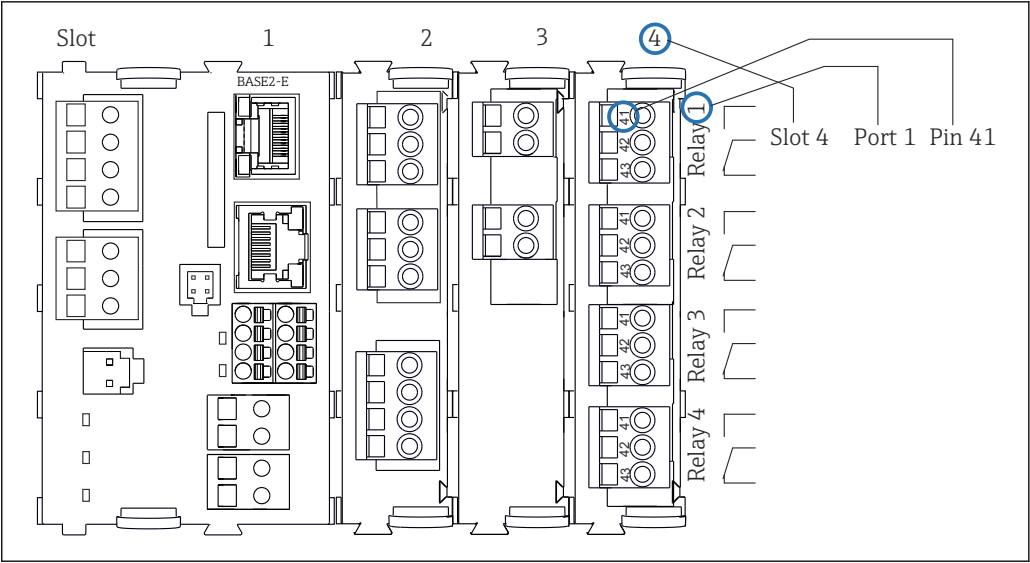


A0039659

5 Creating a terminal diagram using the example of the NO contact (terminal 41) of a relay

Device configuration using
the example of a CM44P-**

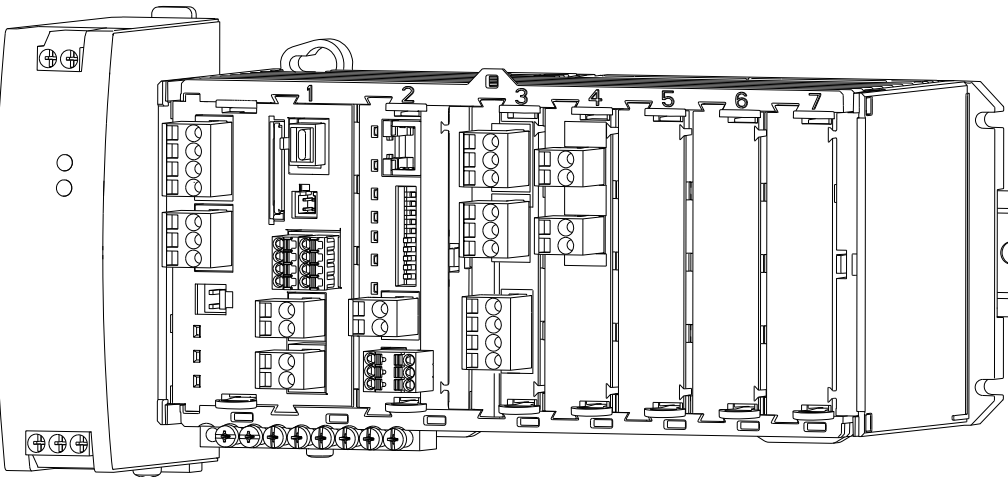	
Ordered basic device (example)	■ CM44P-**DINP1M22A1FA* (cabinet device) ■ Functionality: ■ 1x photometer (module PEM) ■ 2x Memosens (module BASE-E) ■ PROFIBUS communication (module 485) ■ 2 current outputs without HART (on BASE-E module) ■ 2 current inputs (module AI) 3 slots are still free in this example. More or fewer slots can be free in other versions.
Extension options without additional modules	None
Modification options without additional modules	■ Communication type changed by entering activation code. This disables the communication type used previously! ■ Modbus RS485 (71140889) ■ Modbus TCP (71140890) ■ EtherNet/IP (71219868) ■ Retrofit to HART by removing module 485 and entering activation code for HART (71128428)
Extension options by using extension modules in free slots 5-7	Only the following is possible for the example above: ■ Module 2R (71125375) or 4R (71125376): 2 or 4 relays ■ Module DIO (71135638): 2 digital inputs and 2 digital outputs If extended to four Memosens channels: ■ Module 2DS (71135631): 2 Memosens inputs ■ Use of the 2 current outputs in the basic module by entering activation code (71140891) Additional inputs or outputs and relays if fieldbus module 485 is removed: ■ Module 2AO (71135632): 2 current outputs ■ Module AOR (71111053): 2 current outputs, 2 relays ■ Module 2R (71125375) or 4R (71125376): 2 or 4 relays i If you replace module 485 with ETH, you can operate up to 6 current outputs in addition to the ETH module's ethernet or Modbus function. Only two current outputs are possible with 485.
Basic rule for extensions	The sum of all current inputs and outputs may not exceed 8!
Restrictions if using CUS71D sensors for interface measurement	If CUS71D sensors are used, the maximum number of Memosens inputs is limited to two. Any combination of CUS71D or other sensors is possible.
Product Configurator	www.endress.com/cm44p

**Block circuit diagram of
CM44P-****

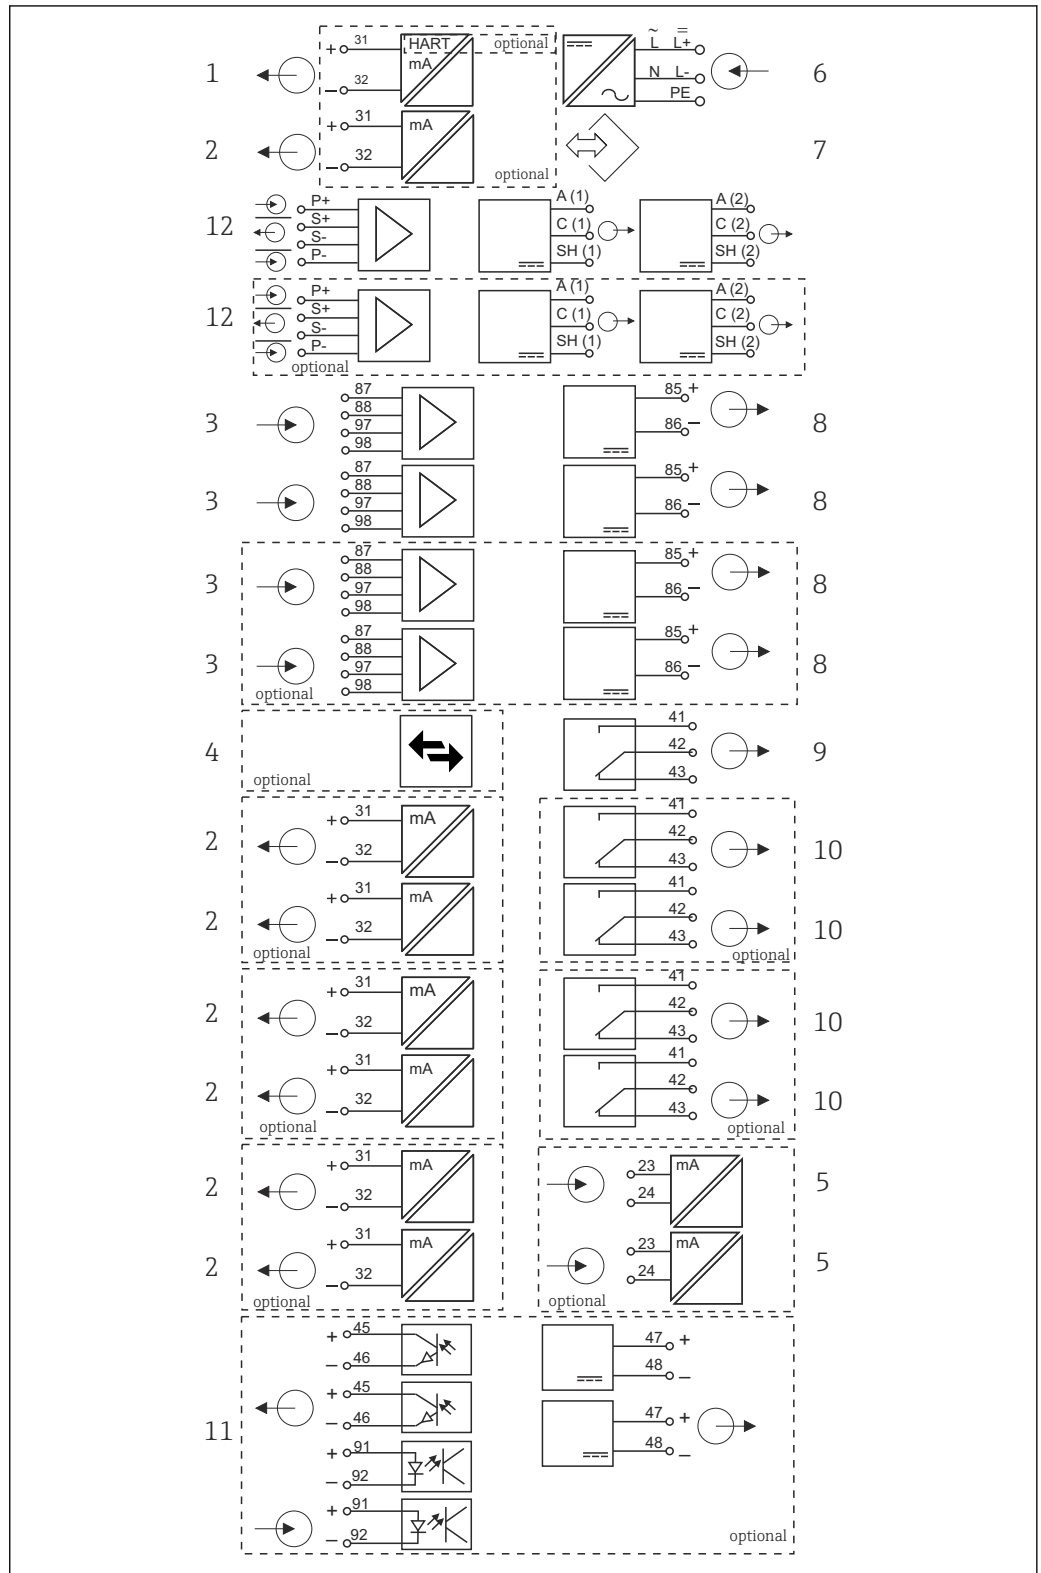

6 Block circuit diagram of CM444P

- | | | | |
|---|--|----|--|
| 1 | Current output 1:1, + HART (both optional) | 7 | Service interface |
| 2 | Max. 7 x current output (optional) | 8 | Power supply, fixed cable sensors |
| 3 | Memosens input (2 x standard + 2 x optional) | 9 | Alarm relay |
| 4 | PROFIBUS DP/Modbus/Ethernet (optional) | 10 | 2 or 4 x relays (optional) |
| 5 | 2 x current input (optional) | 11 | 2 digital inputs and outputs (optional) |
| 6 | Power supply | 12 | Photometer: 2x lamp voltage and detector |

Communication and data processing

Communication protocols:

Fieldbus systems

- HART
- PROFIBUS DP (Profile 3.02)
- Modbus TCP or RS485
- PROFINET
- EtherNet/IP



Only one type of fieldbus communication can ever be active. The last activation code entered decides which bus is used.

The device drivers available make it possible to perform a basic setup and display measured values and diagnostics information via the fieldbus. A full device configuration via the fieldbus is not possible.

Extension module 485 and current outputs

For PROFIBUS DP and Modbus RS485 communication protocols:

A maximum of 2 current outputs can be used in parallel.

Ethernet functionality via Base2 module and current outputs

A maximum of 6 current outputs can be used in parallel.

Bus termination on the device

- Via slide switch at bus module 485
- Displayed via LED "T" on bus module 485

Dependability

Reliability

Memosens

Memosens makes your measuring point safer and more reliable:

- Non-contact, digital signal transmission enables optimum galvanic isolation
- No contact corrosion
- Completely watertight
- Sensor can be calibrated in a lab, thus increasing the availability of the measuring point in the process
- Intrinsically safe electronics mean operation in hazardous areas is not a problem.
- Predictive maintenance thanks to recording of sensor data, e.g.:
 - Total hours of operation
 - Hours of operation with very high or very low measured values
 - Hours of operation at high temperatures
 - Number of steam sterilizations
 - Sensor condition

Heartbeat diagnostics

- Heartbeat diagnostics screen with graphic indicators for the health of the device and sensor and with a maintenance or (sensor-dependent) calibration timer
- Heartbeat status information on the health of the device and the condition of the sensor
 - ☺: Sensor/device condition or maintenance timer > 20 %; no action is required
 - ☹: Sensor/device condition or maintenance timer > 5 ≤ 20 %, maintenance not yet urgent but should be scheduled
 - ☹: Sensor/device condition or maintenance timer < 5 %, maintenance is recommended
- The Heartbeat sensor condition is the assessment of the calibration results and the sensor diagnostic functions.

An unhappy smiley can be due to the calibration result, the measured value status or to the operating hours limit having been exceeded. These limits can be configured in the sensor setup in a way that adapts the Heartbeat diagnostics to the application.

Heartbeat and NAMUR category

The Heartbeat status indicates the sensor or device condition while the NAMUR categories (F, C, M, S) assess the reliability of the measured value. The two conditions can correlate but do not have to.

■ Example 1

- The number of remaining cleaning cycles for the sensor reaches 20% of the defined maximum number. The Heartbeat symbol changes from ☺ to ☹. The measured value is still reliable so the NAMUR status signal does not change.
- If the maximum number of cleaning cycles is exceeded, the Heartbeat symbol changes from ☹ to ☹. While the measured value can still be reliable, the NAMUR status signal changes to M (maintenance required).

■ Example 2

The sensor breaks. The Heartbeat status changes immediately from ☺ to ☹ and the NAMUR status signal also changes immediately to F (failure).

Heartbeat Monitoring

Sensor data from Memosens sensors are transmitted via the EtherNet/IP, PROFINET, PROFIBUS DP, HART, Modbus RTU and Modbus TCP fieldbus protocols. These data can be used for predictive maintenance, for instance.

Examples include:

- Total hours of operation
- Hours of operation with very high or very low measured values
- Hours of operation at high temperatures
- Number of steam sterilizations
- Sensor identification
- Calibration information



For detailed information on "Ethernet/IP communication", see the product pages on the Internet (→ SD01293C).



For detailed information on "Modbus communication", see the product pages on the Internet (→ SD01189C).



For detailed information on "PROFINET communication", see the product pages on the internet (→ SD02490C).



For detailed information on "PROFIBUS communication", see the product pages on the Internet (→ SD01188C).



More detailed information on HART communication is provided on the product pages on the Internet (→ SD01187C).

Heartbeat Verification

Heartbeat Verification makes it possible to verify the correct operation of the measuring device without interrupting the process. This verification can be documented anytime.

Sensor Check System (SCS)

The Sensor Check System (SCS) monitors the high impedance of the pH glass. An alarm is issued if a minimum impedance value is undershot or a maximum impedance is exceeded.

- Glass breakage is the main reason for a drop in high impedance values
- The reasons for increasing impedance values include:
 - Dry sensor
 - Worn pH glass membrane

Process Check System (PCS)

The process check system (PCS) checks the measuring signal for stagnation. An alarm is triggered if the measuring signal does not change over a specific period (several measured values).

The main causes of stagnating measured values are:

- Contaminated sensor, or sensor outside of medium
- Sensor defective
- Process error (e.g. through control system)

Self-monitoring functions

Current inputs are deactivated in the event of overcurrent and reactivated once the overcurrent stops. Board voltages are monitored and the board temperature is also measured.

USP and EP

The limit functions for pharmaceutical water in accordance with USP and EP specifications are implemented in the software for conductivity measurements:

- "Water for Injection" (WFI) as per USP <645> and EP
- "Highly Purified Water" (HPW) as per EP
- "Purified Water" (PW) as per EP

The uncompensated conductivity value and the temperature are measured for the USP/EP limit functions. The measured values are compared against the tables defined in the standards. An alarm is triggered if the limit value is exceeded. Furthermore, it is also possible to configure an early warning alarm that signals undesired operating states before they occur.

ChemocleanPlus

Freely programmable sequence control


- e.g. for automatic sensor cleaning in retractable assemblies for reliable measurement results in processes with a high risk of contamination
- Individual, time-based activation of 4 outputs e.g. relays
- Starting, stopping or pausing of activities via digital input or fieldbus signals e.g. from limit position switches

Maintainability

Modular design

The modular transmitter design means it can be easily adapted to suit your needs:

- Retrofit extension modules for new or extended range of functions, e.g. current outputs, relays and digital communication
- Upgrade to maximum 2 photometers and 4 Memosens inputs
- Optional: M12 sensor connector for connecting any kind of Memosens sensor
- Optional: CDI connector for external access to the service interface (avoids having to unscrew the housing cover)

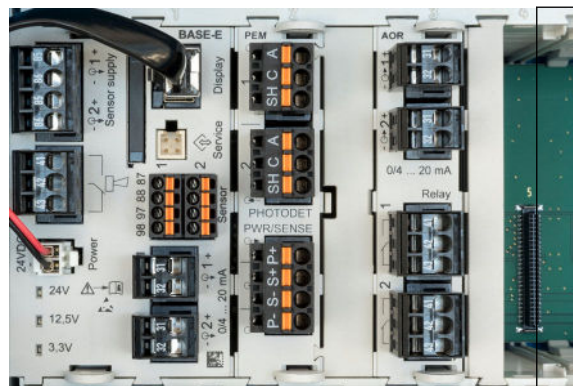

7 CM44P: example

A0034282




8 Extension module

A0042346

Data logger function

- Adjustable scan time: 1 to 3600 s (1 h)
- Data logbooks:
 - Max. 8 data logbooks
 - 150,000 entries per logbook
 - Graphic display (load curves) or numerical list
- Calibration logbook: max. 75 entries
- Hardware version logbook:
 - Hardware configuration and modifications
 - Max. 125 entries
- Version logbook:
 - E.g. software updates
 - Max. 50 entries
- Operation logbook: max. 250 entries
- Diagnostics logbook: max. 250 entries

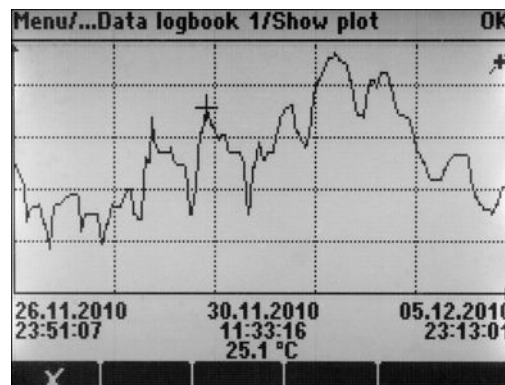

A0015032

9 Data logbook: Graphic display

 Logbooks remain unchanged even after a software update.

SD card

The exchangeable storage medium enables:

- Quick and easy software updates and upgrades
- Data storage of internal device memory (e.g. logbooks)
- Transfer of complete configurations to a device with an identical setup (backup function)
- Transfer of configurations without the TAG and bus address to devices with an identical setup (copy function)
- Saving of screenshots for documentation purposes

Endress+Hauser offers industry-approved SD cards as accessories. These memory cards provide maximum data security and integrity.

Other SD cards up to a maximum weight of 5 g can also be used. However, Endress+Hauser does not accept any responsibility for the data security of such cards.

External signals for device control and for activating external devices

Hardware options, e.g. module "DIO" with 2 digital inputs and 2 digital outputs or fieldbus module "485" enable the following:

- via a digital input signal
 - measuring range switching for conductivity (upgrade code required, see accessories)
 - switching between different calibration datasets in the case of optical sensors
 - an external hold
 - a cleaning interval to be triggered
 - switching on and off a PID controller, e.g. via the proximity switch of the CCA250
 - the use of the input as an "analog input" for pulse-frequency modulation (PFM)
- via a digital output signal
 - the static transmission (similar to a relay) of diagnostic states, point level switch states etc.
 - the dynamic transmission (comparable to a non-wearing "analog output") of PFM signals, e.g. to control dosing pumps.

FieldCare and Field Data Manager

FieldCare


Configuration and asset management software based on FDT/DTM technology

- Complete device configuration when connected via FXA291 and service interface
- Access to a number of configuration parameters and identification, measuring and diagnostic data when connected via HART modem
- Logbooks can be downloaded in CSV format or binary format for "Field Data Manager" software

Field Data Manager

Visualization software and database for measuring, calibration and configuration data

- SQL database which is protected against manipulation
- Functions to import, save and print out logbooks
- Load curves to display measured values

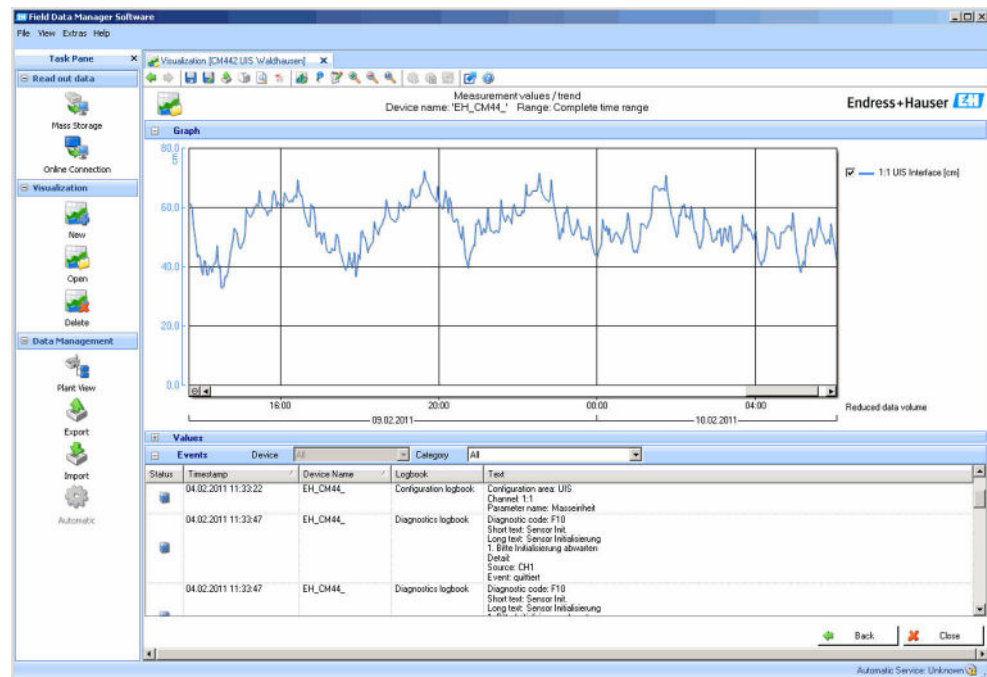

A0016009

10 Field Data Manager: Load curves

Virtual process values (mathematical functions)

In addition to "real" process values, which are provided by connected physical sensors or analog inputs, mathematical functions can be used to calculate a maximum of 8 "virtual" process values.

The "virtual" process values can be:

- Output via a current output or a fieldbus
- Used as a controlled variable
- Assigned as a measured variable to a limit switch
- Used as a measured variable to trigger cleaning
- Displayed in user-defined measuring menus

The following mathematical functions are possible:

- Calculation of pH from two conductivity values according to VGB 405 RL, e. g. in boiler feedwater
- Difference between two measured values from different sources, e. g. for membrane monitoring
- Differential conductivity, e. g. for monitoring the efficiency of ion exchangers
- Degassed conductivity, e. g. for process controls in power plants
- Redundancy for monitoring two or three redundant sensors
- rH calculation based on the measured values of a pH and an ORP sensor
- Calculation of the remaining capacity of a cation exchanger
- Formula editor

Concentration tables

When the device is delivered from the factory, tables are saved in the device that allow inductive conductivity measurements to be converted to concentrations of certain substances. 4 user-defined tables are also possible.

The following factory concentration tables are available:

NaOH	0 to 15 %	0 to 100 °C (32 to 212 °F)
NaOH	25 to 50%	2 to 80 °C (36 to 176 °F)
HCl	0 to 20 %	0 to 65 °C (32 to 149 °F)
HNO ₃	0 to 30 %	2 to 80 °C (36 to 176 °F)
H ₂ SO ₄	0.5 to 27 % and 35 to 85 %	0 to 100 °C (32 to 212 °F)
H ₂ SO ₄	93 to 100 %	10 to 115 °C (50 to 239 °F)
H ₃ PO ₄	0 to 40 %	2 to 80 °C (36 to 176 °F)
NaCl	0 to 26 %	2 to 80 °C (36 to 176 °F)

Security**Real-time clock**

The device has a real-time clock, which is buffered by a button cell battery if the power supply fails.

This ensures that the device continues to keep the correct date and time when it is restarted and that the time stamp for the logbooks is correct.

Data security

All settings, logbooks etc. are stored in a non-volatile memory to ensure that the data are retained even in the event of a disruption to the power supply.

Measuring range switching for conductivity

- Can be used in CIP processes e.g. for safe monitoring of phase separations
- Switching between 4 complete parameter sets:
 - Conductivity operating mode
 - Concentration tables
 - Temperature compensation
 - Output signal range
 - Limit value switch
- Via digital inputs or fieldbus

Measured value compensation for oxygen and conductivity

- Pressure or temperature compensation
- Input signals from external sensors via current input or fieldbus
- Signals from connected temperature sensors

Password protection

Password-protected login

- For remote operation via web server
- For local operation

Process safety

Two independent PID controllers

- One- or two-sided control
- Limit switches
- 4 cleaning programs which can be programmed independently of each other

IT security

Our warranty is valid only if the device is installed and used as described in the Operating Instructions. The device is equipped with security mechanisms to protect it against any inadvertent changes to the settings.

IT security measures, which provide additional protection for the device and associated data transfer, must be implemented by the operators themselves in line with their security standards.

Input

Measured variables	Photometer ■ Absorption (UV, color, NIR, cell growth) ■ Turbidity Memosens sensors → Documentation of the connected sensor
Measuring ranges	Photometer OUSAF12, OUSAF21, OUSAF22, OUSAF44, OUSAF46 ■ 0 to 2.5 AU ■ Max. 50 OD (depending on the optical path length) OUSAF11 ■ 0 to 3 AU ■ 0 to 6 OD (depending on the optical path length) OUSTF10 ■ 0 to 200 FTU ■ 0 to 200 ppm DE OUSBT66 ■ 0 to 4 AU ■ 0 to 8 OD (depending on the optical path length) Memosens sensors → Documentation of the connected sensor
Types of input	■ Digital sensor inputs for sensors with Memosens protocol ■ Analog current inputs (optional) ■ Digital inputs (optional) ■ Digital sensor inputs for intrinsically safe sensors with Memosens protocol and Ex approval (optional) ■ Analog photometer inputs
Input signal	Depending on version: ■ Max. 2 x analog photometers ■ max. 4 x binary sensor signal ■ 2 x 0/4 to 20 mA (optional), passive, potentially isolated from one another and from the sensor inputs ■ 0 to 30 V
Cable specification	Cable type ■ Cable set CUK80 for photometer sensors ■ Memosens data cable CYK10 or sensor fixed cable, each with cable end sleeves or M12 round-pin connector (optional, for field housing)  Only Memosens data cables CYK10 with an appropriate approval may be connected to the intrinsically safe digital sensor inputs of the sensor communication module 2DS Ex-i. Cable length <i>All sensors except OUSBT66</i> Max. 100 m (330 ft) <i>OUSBT66</i> Maximum 20 m (65 ft)

Digital inputs, passive

Electrical specification	■ drawing power (passive) ■ Galvanically isolated
Span	■ High: 11 to 30 V DC ■ Low: 0 to 5 V DC
Nominal input current	max. 8 mA
PFM function	Minimum pulse width: 500 µs (1 kHz)
Test voltage	500 V
Cable specification	Max. 2.5 mm ² (14 AWG)

Current input, passive

Span	> 0 to 20 mA
Signal characteristic	Linear
Internal resistance	Non-linear
Test voltage	500 V

Output

Output signal	Depending on version: ■ 2 x 0/4 to 20 mA, active, galvanically isolated from one another and from the sensor circuits ■ 4 x 0/4 to 20 mA, active, galvanically isolated from one another and from the sensor circuits ■ 6 x 0/4 to 20 mA, active, galvanically isolated from one another and from the sensor circuits ■ 8 x 0/4 to 20 mA, active, galvanically isolated from one another and from the sensor circuits ■ Optional HART communication (only via current output 1:1)
----------------------	--

HART	
Signal encoding	FSK ± 0.5 mA via current signal
Data transmission rate	1200 baud
Galvanic isolation	Yes
Load (communication resistor)	250 Ω

PROFIBUS DP/RS485	
Signal encoding	EIA/TIA-485, PROFIBUS DP-compliant acc. to IEC 61158
Data transmission rate	9.6 kBd, 19.2 kBd, 45.45kBd, 93.75 kBd, 187.5 kBd, 500 kBd, 1.5 MBd, 6 MBd, 12 MBd
Galvanic isolation	Yes
Connectors	Spring terminal (max. 1.5 mm), bridged internally (T-function), optional M12
Bus termination	Internal slide switch with LED display

Modbus RS485	
Signal encoding	EIA/TIA-485
Data transmission rate	2,400, 4,800, 9,600, 19,200, 38,400, 57,600 and 115,200 baud
Galvanic isolation	Yes
Connectors	Spring terminal (max. 1.5 mm), bridged internally (T-function), optional M12
Bus termination	Internal slide switch with LED display

Ethernet and Modbus TCP	
Signal encoding	IEEE 802.3 (Ethernet)
Data transmission rate	10/100 MBd
Galvanic isolation	Yes
Connection	RJ45
IP address	DHCP (default) or configuration via menu

EtherNet/IP	
Signal encoding	IEEE 802.3 (Ethernet)
Data transmission rate	10/100 MBd
Galvanic isolation	Yes
Connection	RJ45
IP address	DHCP (default) or configuration via menu

PROFINET	
Signal encoding	IEEE 802.3 (Ethernet)
Data transmission rate	100 MBd
Galvanic isolation	Yes
Connection	RJ45
Name of station	Via DCP protocol using the configuration tool (e.g. Siemens PRONETA)
IP address	Via DCP protocol using the configuration tool (e.g. Siemens PRONETA)

Signal on alarm

Adjustable, as per NAMUR Recommendation NE 43

- In measuring range 0 to 20 mA (HART is not available with this measuring range):
Failure current from 0 to 23 mA
- In measuring range 4 to 20 mA:
Failure current from 2.4 to 23 mA
- Factory setting for failure current for both measuring ranges:
21.5 mA

LoadMax. 500 Ω **Linearization/transmission behavior**

Linear

Digital outputs, passive

Electrical specification	■ Passive ■ Open collector, max. 30 V, 15 mA ■ Maximum voltage drop 3 V
External power supply	When using an onsite auxiliary voltage supply and an onsite digital input: Recommended minimum auxiliary voltage = $3\text{ V} + V_{IHmin}$ (V_{IHmin} = minimum input voltage required (high-level input voltage))
PFM function	Minimum pulse width: 500 μs (1 kHz)
Auxiliary voltage	Electrical specification ■ Galvanically isolated ■ Unregulated, 24 V DC ■ Max. 50 mA (per DIO module)
Test voltage	500 V
Cable specification	Max. 2.5 mm ² (14 AWG)

Current outputs, active

Span	0 to 23 mA 2.4 to 23 mA for HART communication
Signal characteristic	Linear
Electrical specification	Output voltage Max. 24 V Test voltage 500 V
Cable specification	Cable type Recommended: shielded cable Cable specification Max. 2.5 mm ² (14 AWG)

Relay outputs

Electrical specification	Relay types ■ 1 single-pin changeover contact (alarm relay) ■ 2 or 4 single-pin changeover contacts (optional with extension modules) Maximum load ■ Alarm relay: 0.5 A ■ All other relays: 2.0 A
---------------------------------	---

Relay switching capacity*Base module (Alarm relay)*

Switching voltage	Load (max.)	Switching cycles (min.)
230 V AC, $\cos\Phi = 0.8$ to 1	0.1 A	700,000
	0.5 A	450,000
115 V AC, $\cos\Phi = 0.8$ to 1	0.1 A	1,000,000
	0.5 A	650,000
24 V DC, L/R = 0 to 1 ms	0.1 A	500,000
	0.5 A	350,000

Extension modules

Switching voltage	Load (max.)	Switching cycles (min.)
230 V AC, $\cos\Phi = 0.8$ to 1	0.1 A	700,000
	0.5 A	450,000
	2 A	120,000
115 V AC, $\cos\Phi = 0.8$ to 1	0.1 A	1,000,000
	0.5 A	650,000
	2 A	170,000
24 V DC, L/R = 0 to 1 ms	0.1 A	500,000
	0.5 A	350,000
	2 A	150,000

Cable specificationMax. 2.5 mm² (14 AWG)**Protocol-specific data**

HART	Manufacturer ID	11 _h
	Device type	155D _h
	Device revision	001 _h
	HART version	7.2
	Device description files (DD/DTM)	www.endress.com/hart Device Integration Manager DIM
	Device variables	16 user-definable and 16 predefined device variables, dynamic variables PV, SV, TV, QV
	Supported features	PDM DD, AMS DD, DTM, Field Xpert DD

PROFIBUS DP	Manufacturer ID	11 _h		
	Device type	155D _h		
	Profile version	3.02		
	GSD files	www.endress.com/profibus Device Integration Manager DIM		
	Output values	16 AI blocks, 8 DI blocks		
	Input variables	4 AO blocks, 8 DO blocks		
	Supported features	■ 1 MSCY0 connection (cyclical communication, master class 1 to slave) ■ 1 MSAC1 connection (acyclical communication, master class 1 to slave) ■ 2 MSAC2 connections (acyclical communication, master class 2 to slave) ■ Device lock: The device can be locked using the hardware or software. ■ Addressing using DIL switches or software ■ GSD, PDM DD, DTM		
Modbus RS485	Protocol	RTU/ASCII		
	Function codes	03, 04, 06, 08, 16, 23		
	Broadcast support for function codes	06, 16, 23		
	Output data	16 measured values (value, unit, status), 8 digital values (value, status)		
	Input data	4 setpoints (value, unit, status), 8 digital values (value, status), diagnostic information		
	Supported features	Address can be configured using switch or software		
Modbus TCP	TCP port	502		
	TCP connections	3		
	Protocol	TCP		
	Function codes	03, 04, 06, 08, 16, 23		
	Broadcast support for function codes	06, 16, 23		
	Output data	16 measured values (value, unit, status), 8 digital values (value, status)		
	Input data	4 setpoints (value, unit, status), 8 digital values (value, status), diagnostic information		
	Supported features	Address can be configured using DHCP or software		
EtherNet/IP	Log	EtherNet/IP		
	ODVA certification	Yes		
	Device profile	Generic device (product type: 0x2B)		
	Manufacturer ID	0x049E _h		
	Device type ID	0x109C _h		
	Polarity	Auto-MIDI-X		
	Connections	CIP	12	
		I/O	6	
		Explicit message	6	
		Multicast	3 consumers	
	Minimum RPI	100 ms (default)		

Maximum RPI	10000 ms	
System integration	EtherNet/IP	EDS
	Rockwell	Add-on-Profile Level 3, Faceplate for Factory Talk SE
IO data	Input (T → O)	Device status and diagnostic message with highest priority Measured values: ■ 16 AI (analog input) + Status + Unit ■ 8 DI (discrete input) + Status
	Output (O → T)	Actuating values: ■ 4 AO (analog output) + status + unit ■ 8 DO (discrete output) + Status

PROFINET

Protocol	"Application layer protocol for decentral device periphery and distributed automation", PNIO Version 2.34
Communication type	100 MBit/s
Conformance Class	Conformance Class B
Netload Class	Netload Class II
Baud rate	Automatic 100 Mbps with full-duplex detection
Cycle times	From 32 ms
Device profile	Application interface identifier 0xF600 Generic device
PROFINET interface	1 port, Realtime Class 1 (RT_CLASS_1)
Manufacturer ID	0x11 _h
Device type ID	0x859C D _h
Device description files (GSD)	Information and files under: ■ www.endress.com On the product page for the device: Documents/Software → Device drivers ■ www.profibus.com On the website under Products/Product Finder
Polarity	Auto-polarity for automatic correction of crossed TxD and RxD pairs
Supported connections	■ 1 x AR (IO Controller AR) ■ 1 x AR (IO-Supervisor Device AR connection allowed) ■ 1 x Input CR (Communication Relation) ■ 1 x Output CR (Communication Relation) ■ 1 x Alarm CR (Communication Relation)
Configuration options for measuring device	■ Web browser ■ Manufacturer-specific software (FieldCare, DeviceCare) ■ Device master file (GSD), can be read out via the integrated web server of the measuring device
Configuration of the device name	DCP protocol

Supported functions	■ Identification & Maintenance Simple device identification via: ■ Process control system ■ Nameplate ■ Measured value status The process variables are communicated with a measured value status ■ Blinking feature (FLASH_ONCE) via the local display for simple device identification and assignment ■ Device operation via operating tools (e.g. FieldCare, DeviceCare)
System integration	For information on system integration, see the Operating Instructions ■ Cyclic data transmission ■ Overview and description of the modules ■ Status coding ■ Startup configuration ■ Factory setting

Web server

The Web server enables full access to the device configuration, measured values, diagnostic messages, logbooks and service data via standard WiFi/WLAN/LAN/GSM or 3G routers with a user-defined IP address.

TCP port	80
Supported features	■ Remote-controlled device configuration(1 session) ■ Save/restore device configuration (via SD card) ■ Logbook export (file formats: CSV, FDM) ■ Access to Web server via DTM or Internet Explorer ■ Login ■ Web server can be switched off

Power supply

Supply voltage**CM44P**

Depending on the version,:

- 100 to 230 V AC, 50/60 Hz
Maximum permitted fluctuation of mains supply voltage: $\pm 15\%$ of nominal voltage ¹⁾
- 24 V DC
Maximum permitted fluctuation of mains supply voltage: $+20\%/-15\%$ of nominal voltage ¹⁾

NOTICE**The device does not have a power switch!**

- ▶ Provide a protected circuit breaker in the vicinity of the device at the place of installation.
- ▶ The circuit breaker must be a switch or power switch, and must be labeled as the circuit breaker for the device.
- ▶ At the supply point, the power supply must be isolated from dangerous live cables by double or reinforced insulation in the case of devices with a 24 V supply voltage.

Power consumption**CM44P**

Depending on supply voltage

- 100 to 230 V AC:
Max. 73 VA (field device)
Max. 150 VA (cabinet device) ¹⁾
- 24 V DC:
Max. 68 W (field device)
Max. 59 W (cabinet device) ¹⁾


Fuse

Fuse not exchangeable


¹⁾ *Specifications only apply if used with power unit supplied by manufacturer.

Overvoltage protection	Integrated overvoltage/lightning protection as per EN 61326 Protection category 1 and 3
-------------------------------	--

Cable entries (field device only)*Cable entries for transmitters for the non-hazardous area*

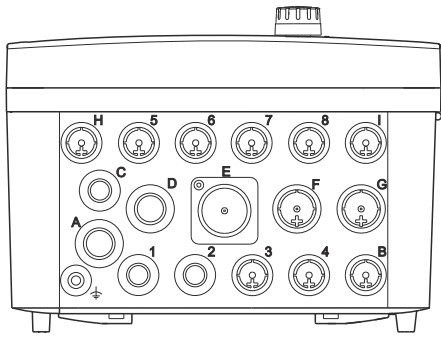Identification of the cable entry on housing base	Suitable gland
B, C, H, I, 1-8	M16x1.5 mm/NPT3/8"/G3/8
A, D, F, G	M20x1.5 mm/NPT1/2"/G1/2
E	-
⏏	M12x1.5 mm
	
Recommended assignment 1-8 Sensors 1-8 A Power supply B Unrestricted use C RS485 Out or M12 Ethernet D,F,G Current outputs and inputs, relays H RS485 In or M12 DP/RS485 I Unrestricted use E Do not use	

Cable entries for transmitters with sensor communication module 2DS Ex-i for the hazardous area

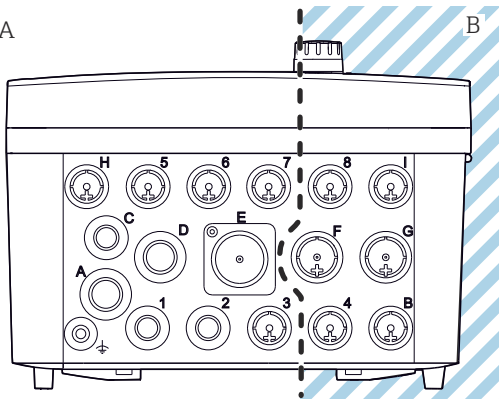Identification of the cable entry on housing base	Suitable gland
B, C, H, I, 1-8	M16x1.5 mm/NPT3/8"/G3/8
A, D, F, G	M20x1.5 mm/NPT1/2"/G1/2
E	-
⏏	M12x1.5 mm
	
Recommended assignment 1/2/3 Do not use 5/6/7 4/8 Intrinsically safe sensors B/F/G/I A Power supply C RS485 Out or M12 Ethernet D Current outputs and inputs, relays H RS485 In or M12 DP/RS485 E Do not use	

11 A: Non-hazardous area, B: Hazardous area

i Do not cross cables for the non-hazardous area and the hazardous area in the housing. Select a suitable cable entry for the connection.

Cable specification**Length of display cable provided (cabinet device only):**


3 m (10 ft)

Maximum permitted length of a display cable (cabinet device only):

5 m (16.5 ft)

Electrical connection


Connecting the supply voltage

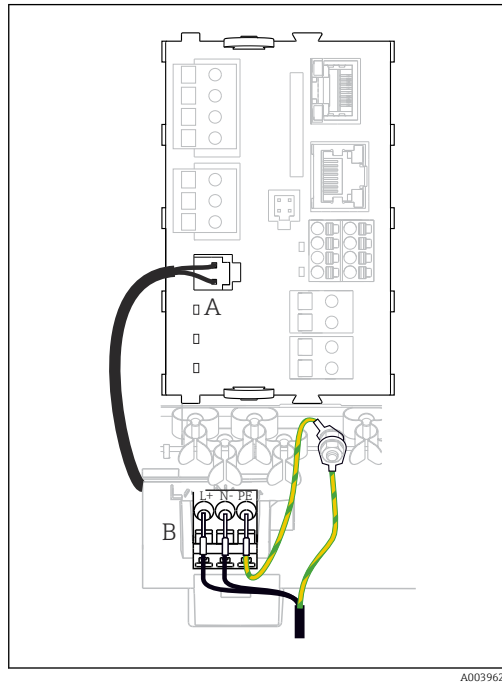

A0039626


12 Power supply connection on the BASE2-E (field device)

A Internal power supply cable
B Extension power unit

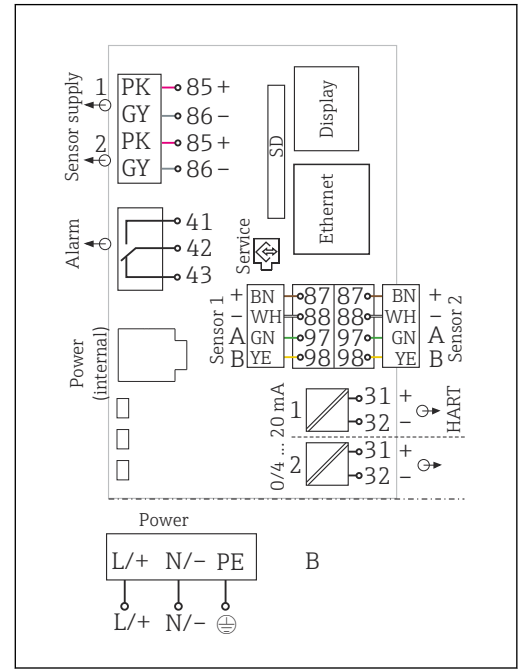

A0039624

13 Overall wiring diagram for BASE2-E and extension power unit (B)

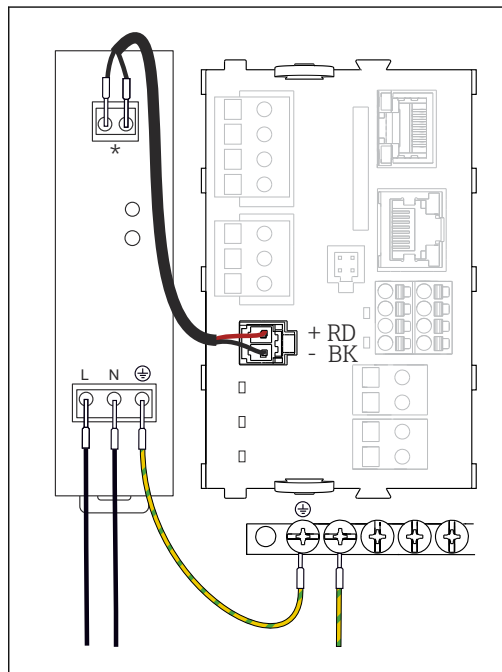


A0039668

14 Connecting power supply with BASE2-E (cabinet device)

* Assignment depending on power unit, make sure to connect correctly



The two device versions may only be operated with the power unit supplied and the power unit cable. Also pay attention to the information in the operating manual supplied for the power unit.

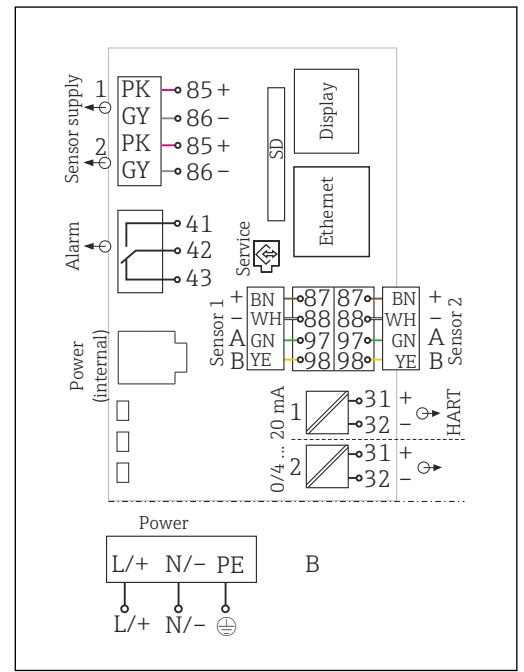

A0039624

15 Overall wiring diagram for BASE2-E and external power unit (B)

Connecting optional modules











With extension modules you can purchase additional functions for your device.











NOTICE**Unacceptable hardware combinations (due to conflicts in power supply)**

Incorrect measurements or total failure of the measuring point as a result of heat build-up or overloading

- ▶ Find out whether the planned extension for your controller results in a permitted hardware combination (Configurator on www.endress.com).
- ▶ Remember that the sum of all current inputs and outputs may not exceed 8.
- ▶ Make sure not to use more than 2 "DIO" modules. More "DIO" modules are not permitted.
- ▶ Please contact your Endress+Hauser sales center should you have any questions.

Overview of all the modules available

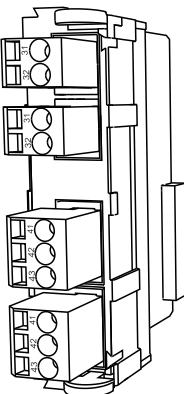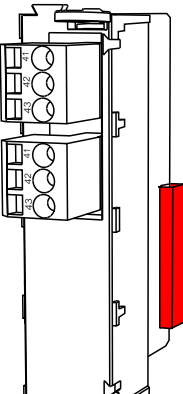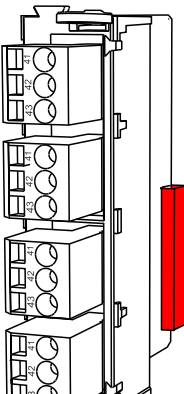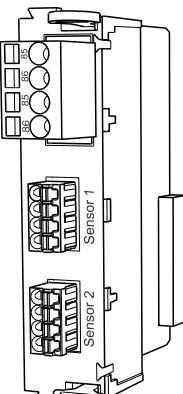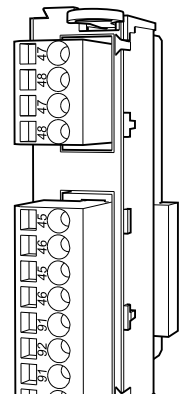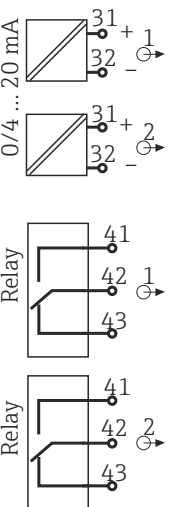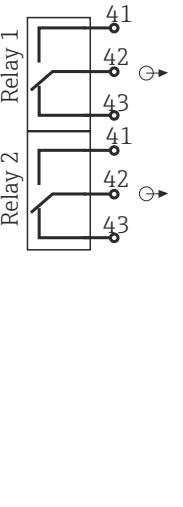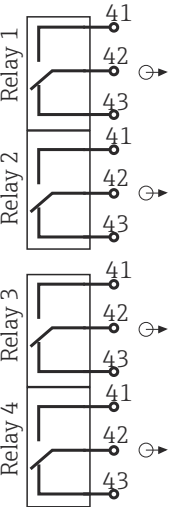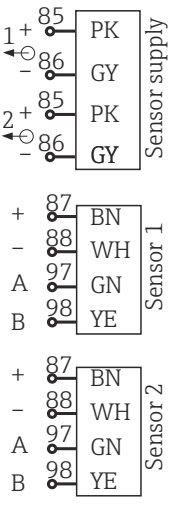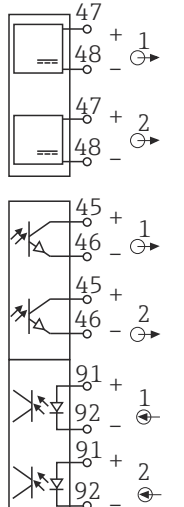Module name				
AOR	2R	4R	2DS	DIO
				
■ 2 x 0/4 to 20 mA analog outputs ■ 2 relays ■ Order No. 71111053	■ 2 relays ■ Order No. 71125375	■ 4 relays ■ Order No. 71125376	■ 2 digital sensor inputs ■ 2 power supply systems for digital sensors ■ Order No. 71135631	■ 2 digital inputs ■ 2 digital outputs with auxiliary voltage ■ Order No. 71135638
				

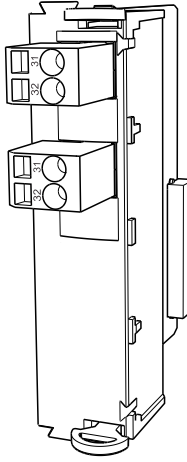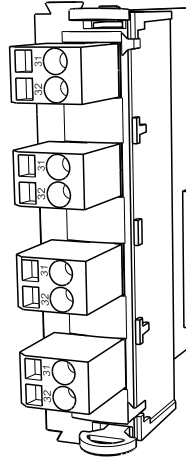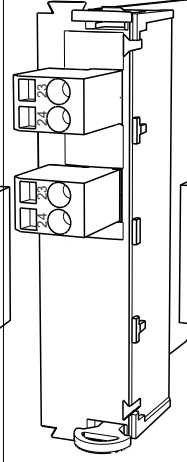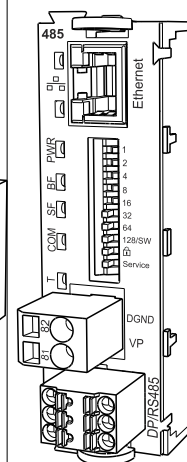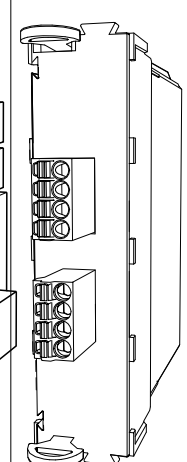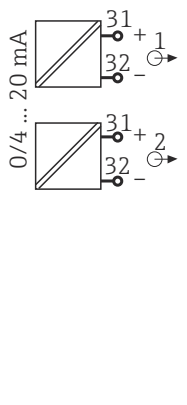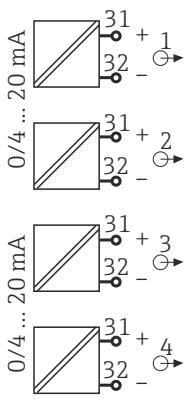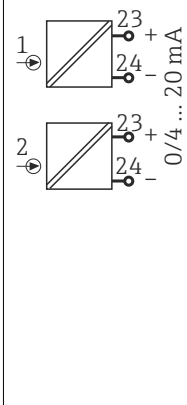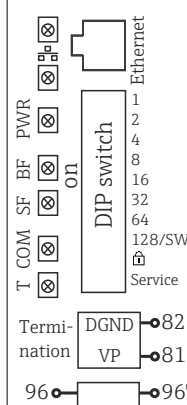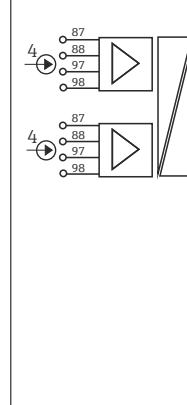
Module name				
2AO	4AO	2AI	485	2DS Ex-i
				
2 x 0/4 to 20 mA analog outputs - Order No. 71135632	4 x 0/4 to 20 mA analog outputs - Order No. 71135633	2 x 0/4 to 20mA analog inputs - Order No. 71135639	- Ethernet (web server or Modbus TCP) 5V power supply for PROFIBUS DP termination - RS485 (PROFIBUS DP or Modbus RS485) - Use of BASE2 module disables Ethernet port of module 485 - Order No. 71135634	2 intrinsically safe digital inputs for Memosens sensors with Ex approval - Inputs on BASE2 module are disabled - Module 2DS EX-i is equipped in the right slot of the device - Order No. 71477718
				



PROFIBUS DP (module 485)


Contacts 95, 96 and 99 are jumpered in the plug. This ensures that PROFIBUS communication is not interrupted if the connector is disconnected.

Protective ground connection

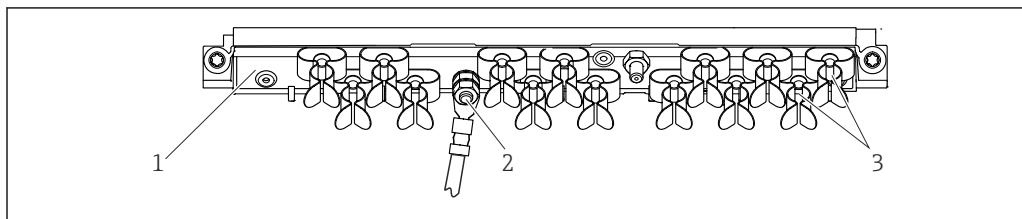

A0048299

16 Cable mounting rail and associated function (field device)

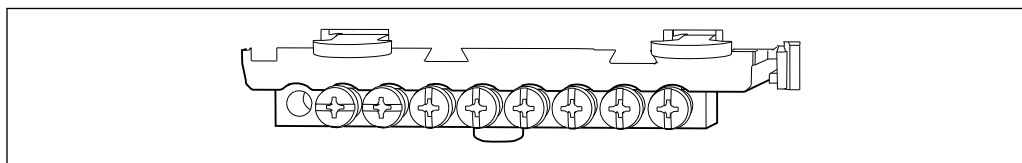

A0025366

17 Mounting rail for functional ground connections (cabinet device)

- 1 Cable mounting rail
- 2 Threaded bolt (protective ground connection, central grounding point)
- 3 Cable clamps (fixing and grounding the sensor cables)

Sensor connection

Sensor types for non-hazardous area

Photometer sensors

Sensor types	Sensor cable	Sensors
Analog photometer sensors without additional internal power supply	CUK80	■ OUSAF12 ■ OUSAF21 ■ OUSAF22 ■ OUSAF44 ■ OUSAF46 ■ OUSTF10 ■ OUSBT66
	Fixed cable	OUSAF11

Sensors with Memosens protocol

Sensor types	Sensor cable	Sensors
Digital sensors without additional internal power supply	With plug-in connection and inductive signal transmission	■ pH sensors ■ ORP sensors ■ Combined sensors ■ Oxygen sensors (amperometric and optical) ■ Conductivity sensors with conductive measurement of conductivity ■ Chlorine sensors (disinfection)
	Fixed cable	Conductivity sensors with inductive measurement of conductivity
Digital sensors with additional internal power supply	Fixed cable	■ Turbidity sensors ■ Sensors for interface measurement ■ Sensors for measuring the spectral absorption coefficient (SAC) ■ Nitrate sensors ■ Optical oxygen sensors ■ Ion-sensitive sensors


The following rule applies if connecting CUS71D sensors:

- The maximum number of Memosens inputs is limited to two.
- Any combination of CUS71D or other sensors is possible.


Types of connection

- Direct connection of the sensor cable to the terminal connector of the sensor module PEM and the Memosens module 2DS or the base module-E (→ 18 ff.)(Memosens sensors only)
- Optional for Memosens sensors: Sensor cable plug connected to the M12 sensor socket on the underside of the device (field device)
With this type of connection, the device is already wired at the factory (→ 22).


Sensor cable connected directly

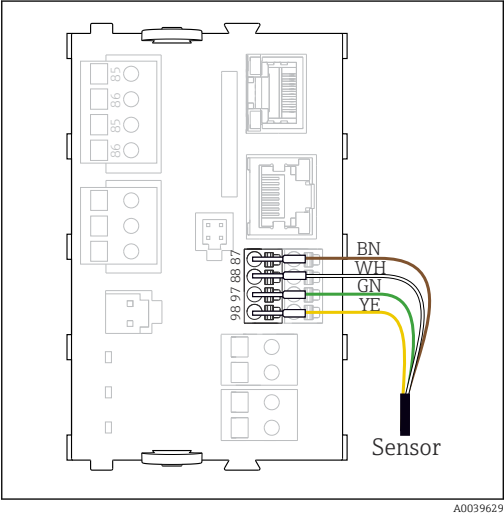


18 Memosens sensors without additional supply voltage

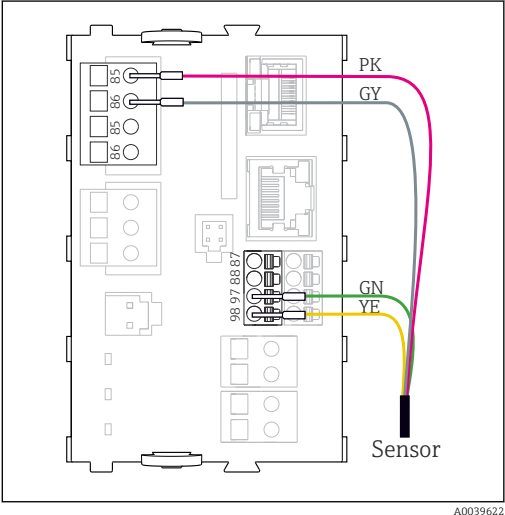

19 Memosens sensors with additional supply voltage

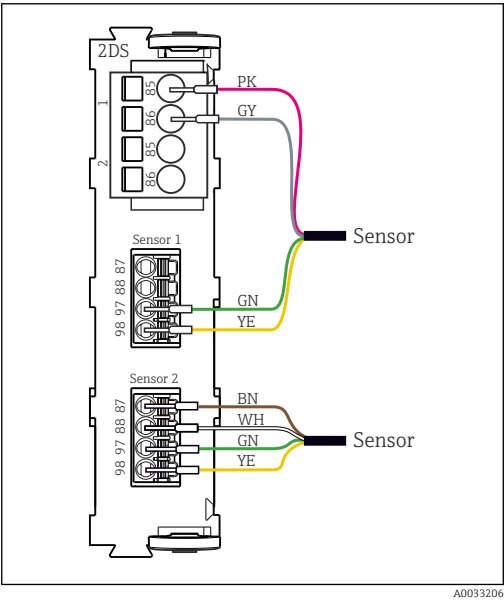

20 Sensors with and without additional supply voltage at sensor module 2DS

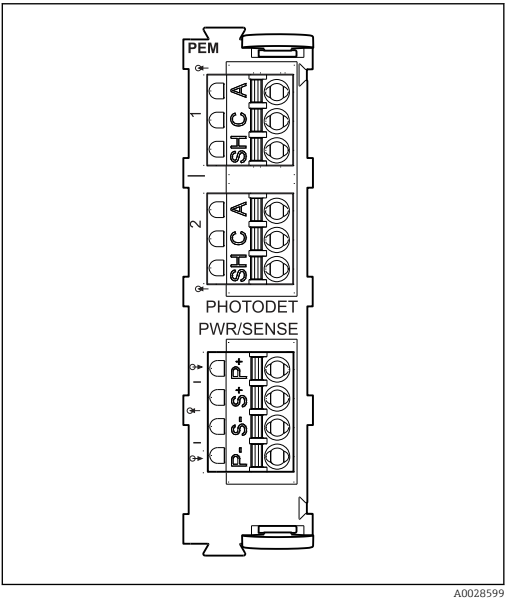

21 PEM module

Connecting photometer sensors to PEM module


Sensor	Cable color	PEM terminal	Assignment
OUSAF11 OUSAF12	YE (thick)	P+	Lamp voltage +
	YE (thin)	S+	Recording lamp voltage +
	BK (thin)	S-	Recording lamp voltage -
	BK (thick)	P-	Lamp voltage -
	RD	A (1)	Sensor +
	BK ¹⁾ / WH ²⁾	C(1)	Sensor -
	GY	SH (1)	Shielding

Sensor	Cable color	PEM terminal	Assignment
OUSAF21	YE (thick)	P+	Lamp voltage +
OUSAF22	YE (thin)	S+	Recording lamp voltage +
OUSTF10	BK (thin)	S-	Recording lamp voltage -
OUSAF44	BK (thick)	P-	Lamp voltage -
	RD	A (1)	Measuring detector sensor +
	BK	C(1)	Measuring detector sensor -
	GY	SH (1)	Measuring detector screening
	WH	A (2)	Sensor reference +
	GN	C(2)	Sensor reference -
	GY	SH (2)	Reference screening
OUSAF46	PEM module 1		
 2 PEM modules necessary	YE (thick)	P+	Lamp voltage +
	YE (thin)	S+	Recording lamp voltage +
	BK (thin)	S-	Recording lamp voltage -
	BK (thick)	P-	Lamp voltage -
	RD	A (1)	Measuring detector sensor +
	BK	C(1)	Measuring detector sensor -
	GY	SH (1)	Measuring detector screening
	WH (lamp)	A (2)	Sensor reference +
	GN (lamp)	C(2)	Sensor reference -
	GY (lamp)	SH (2)	Reference screening
	PEM module 2		
	WH	A (1)	Measuring detector sensor +
	GN	C(1)	Measuring detector sensor -
	GY	SH (1)	Measuring detector screening
	RD (lamp)	A (2)	Sensor reference +
	BK (lamp)	C(2)	Sensor reference -
	GY (lamp)	SH (2)	Reference screening
OUSBT66	BN	P+	Lamp voltage +
	BN	S+	Recording lamp voltage +
	BK	P-	Lamp voltage -
	BK	S-	Recording lamp voltage -
	RD	A (1)	Sensor +
	OG	C(1)	Sensor -
	TP	SH (1)	Shielding

- 1) OUSAF12
2) OUSAF11

Memosens Connection via M12 plug-in connector (field device only)

Only for connection in non-hazardous area.

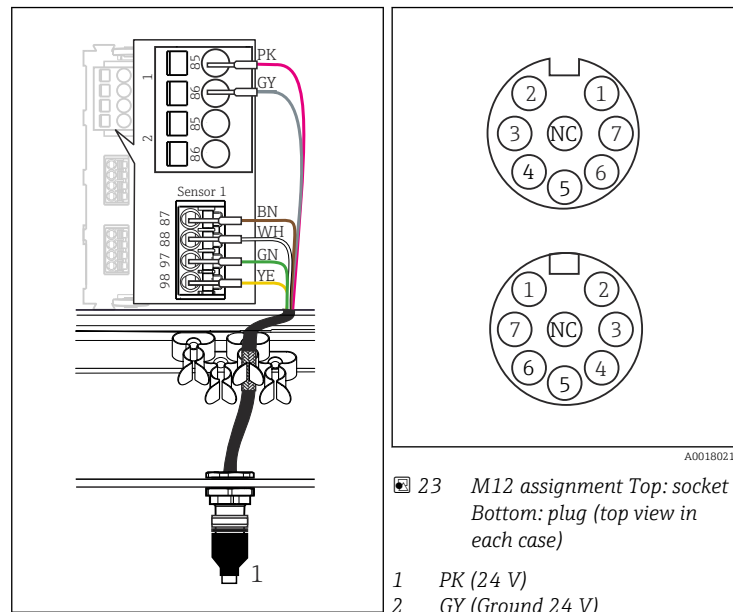

22 M12 plug-in connector (e.g. at sensor module)


1 Sensor cable with M12 plug

i When connecting intrinsically safe sensors to transmitters with sensor communication module type 2DS Ex i, the M12 plug-in connector is **not** permitted.

Connecting intrinsically safe sensors to sensor communication module type 2DS Ex i

Sensor cable connected directly

- Connect the sensor cable to the terminal connector of the sensor communication module 2DS Ex-i.

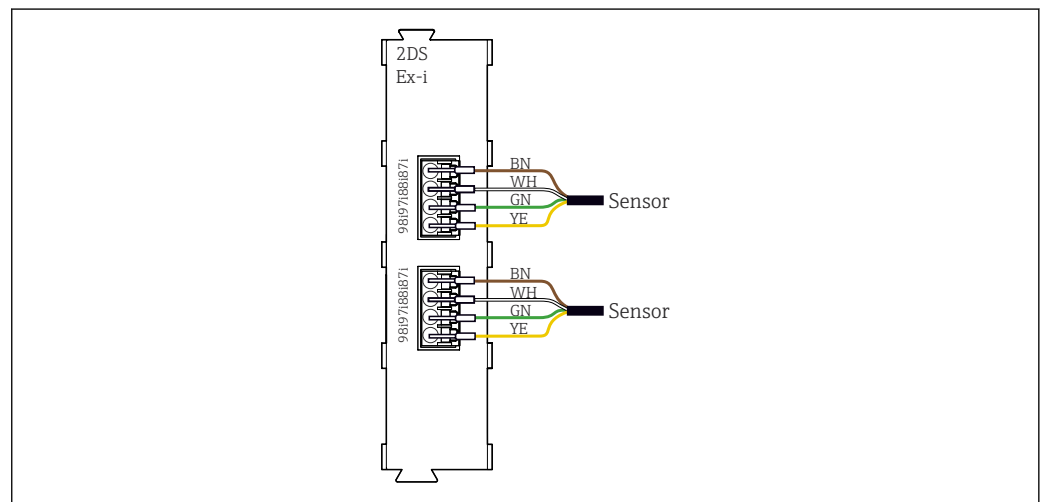

24 Sensors without additional supply voltage at sensor communication module type 2DS Ex-i

i Intrinsically safe sensors for use in explosive atmospheres may only be connected to the sensor communication module type 2DS Ex-i. Only the sensors covered by the certificates may be connected (see XA).


Performance characteristics

Response time	Current outputs t_{90} = max. 500 ms for an increase from 0 to 20 mA Current inputs t_{90} = max. 330 ms for an increase from 0 to 20 mA Digital inputs and outputs t_{90} = max. 330 ms for an increase from low to high
Reference temperature	25 °C (77 °F)
Measured error for sensor inputs	Photometer ■ 0 to 2.5 AU / to 50 OD 0.3 % of measuring range at 25 °C (77 °F) Max. 1 % of measuring range ■ 0 to 200 FTU / 0 to 200 ppm DE Max. 2 % of measuring range  The photometer lamps will not operate at full capacity until a warm-up period of 30 minutes has elapsed. Only then do the specified inaccuracies apply. Memosens sensors → Documentation of the connected sensor
Measured error for current inputs and outputs	Typical measured errors: < 20 µA (with current values < 4 mA) < 50 µA (with current values 4 to 20 mA) at 25 °C (77 °F) each Additional measured error depending on the temperature: < 1.5 µA/K
Frequency tolerance of digital inputs and outputs	≤ 1%
Resolution of current inputs and outputs	< 5 µA
Repeatability	→ Documentation of the connected sensor

Mounting


Mounting requirements

Mounting plate (field device)

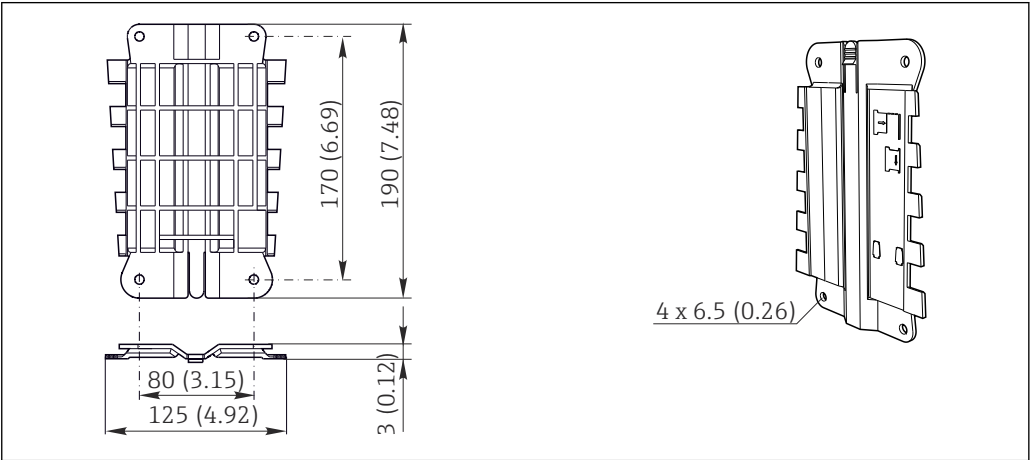

25 Mounting plate, dimensions in mm (in)

Weather protection cover (field device)

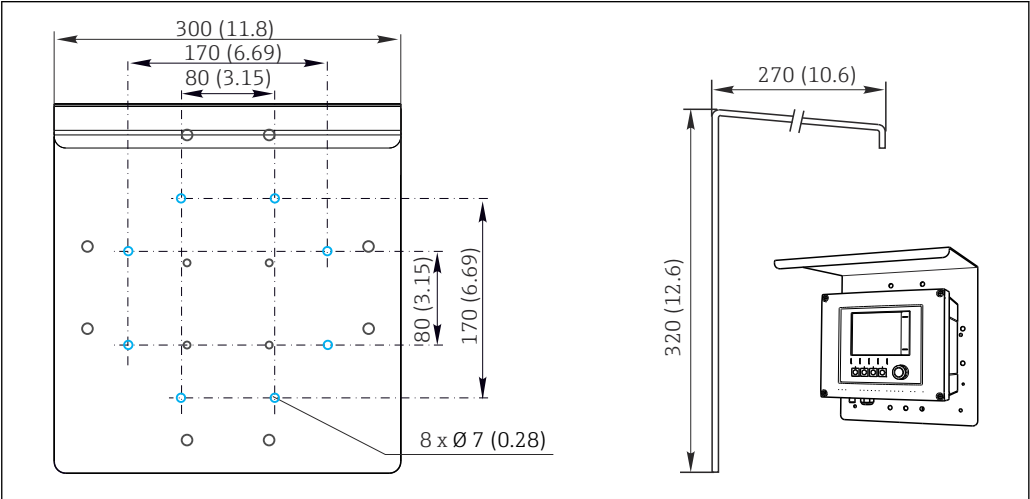


26 Dimensions in mm (in)

Installation

Post mounting

i You require the post mounting kit (optional) to mount the unit on a pipe, post or railing (square or circular, clamping range 20 to 61 mm (0.79 to 2.40")).

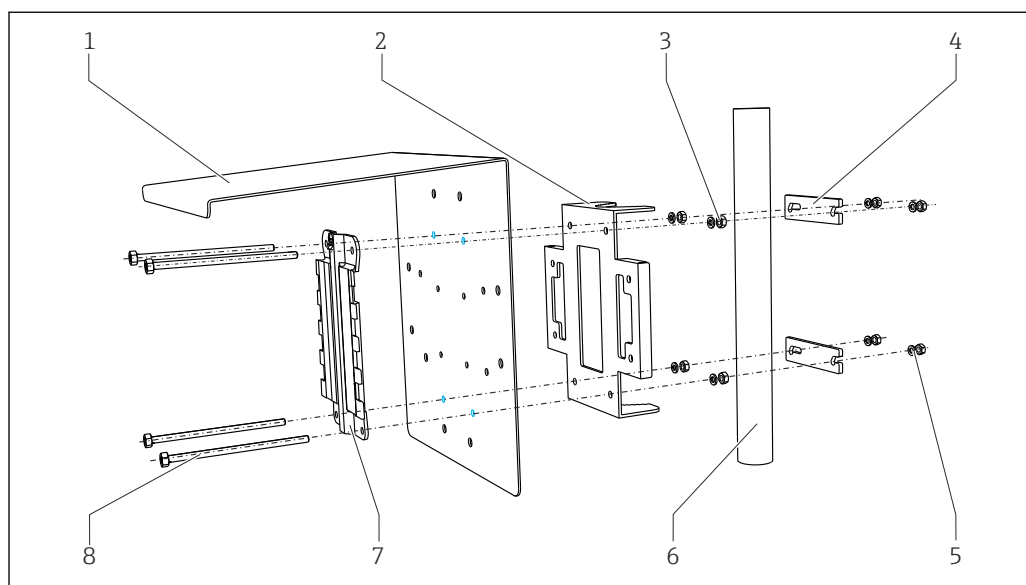


A0033044

27 Post mounting

- | | | | |
|---|---|---|---|
| 1 | Weather protection cover (optional) | 5 | Spring washers and nuts (post mounting kit) |
| 2 | Post mounting plate (post mounting kit) | 6 | Pipe or railing (circular/square) |
| 3 | Spring washers and nuts (post mounting kit) | 7 | Mounting plate |
| 4 | Pipe clamps (post mounting kit) | 8 | Threaded rods (post mounting kit) |

Rail mounting

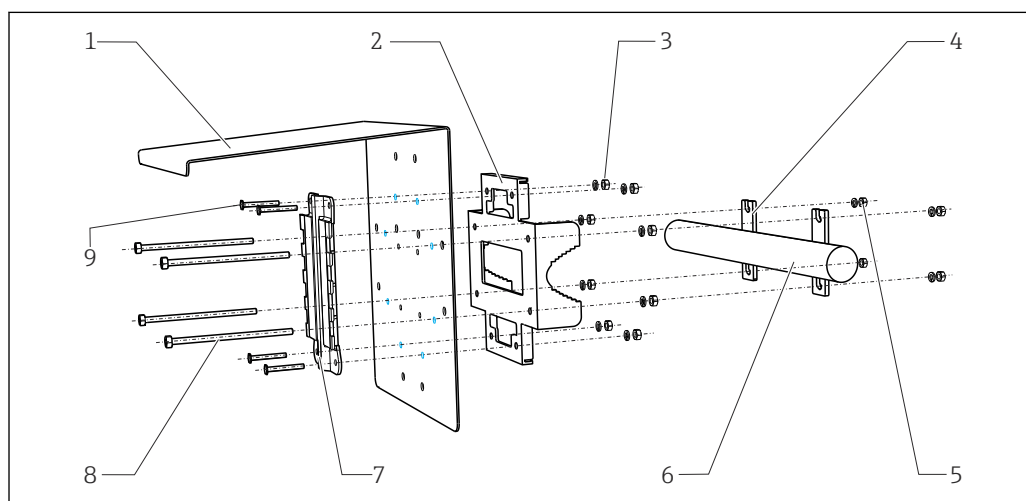


A0012668

28 Rail mounting


- | | | | |
|---|---|---|-----------------------------------|
| 1 | Weather protection cover (optional) | 6 | Pipe or railing (circular/square) |
| 2 | Post mounting plate (post mounting kit) | 7 | Mounting plate |
| 3 | Spring washers and nuts (post mounting kit) | 8 | Threaded rods (post mounting kit) |
| 4 | Pipe clamps (post mounting kit) | 9 | Screws (post mounting kit) |
| 5 | Spring washers and nuts (post mounting kit) | | |

Wall mounting

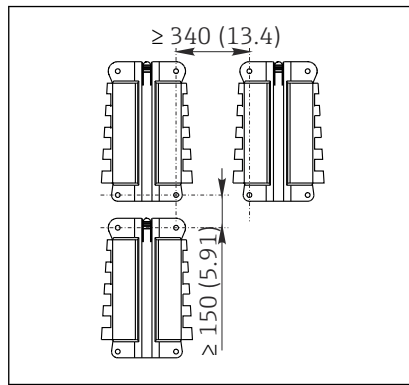

A0012686

29 Installation clearance in mm (in)

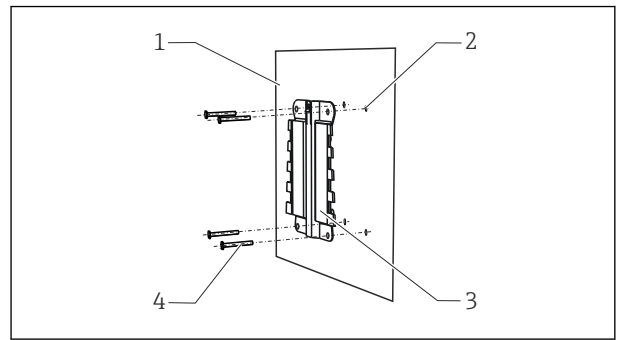

A0027798

30 Wall mounting

- 1 Wall
- 2 4 drill holes ¹⁾
- 3 Mounting plate
- 4 Screws Ø 6 mm (not part of scope of supply)

¹⁾The size of the drill holes depends on the wall plugs used. The wall plugs and screws must be provided by the customer.

Mounting on DIN rail as per IEC 60715

NOTICE


Incorrect mounting location in the cabinet, spacing regulations not observed

Possible malfunctions as a result of heat buildup and interference from neighboring devices!

- ▶ Do not position the device directly above sources of heat. The temperature specification must be observed.
- ▶ The components are designed for convection-based cooling. Avoid heat buildup. Ensure openings are not covered, e.g. by cables.
- ▶ Observe the specified distances to other devices.
- ▶ Physically separate the device from frequency converters and high-voltage devices.
- ▶ Recommended installation direction: horizontal. The specified ambient conditions, and particularly the ambient temperatures, only apply for horizontal installation.
- ▶ Vertical orientation is also possible. However, this requires additional fixing clips at the place of installation to hold the device in position on the DIN rail.
- ▶ Recommended installation of power unit: to the left of the device.

The following minimum clearance specifications must be observed:


- Distances at the side in relation to other devices incl. power units and to the wall of the cabinet:
at least 20 mm (0.79 inch)
- Distance above and below the device and depth distance (to control cabinet door or other devices installed there):
at least 50 mm (1.97 inch)

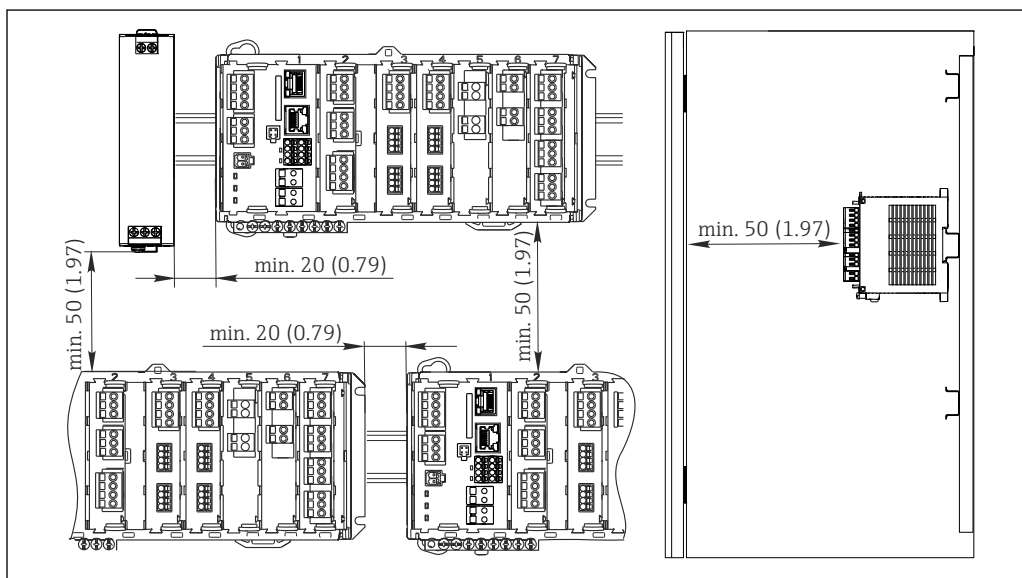

A0039736

31 Minimum clearance in mm (in)

Wall mounting

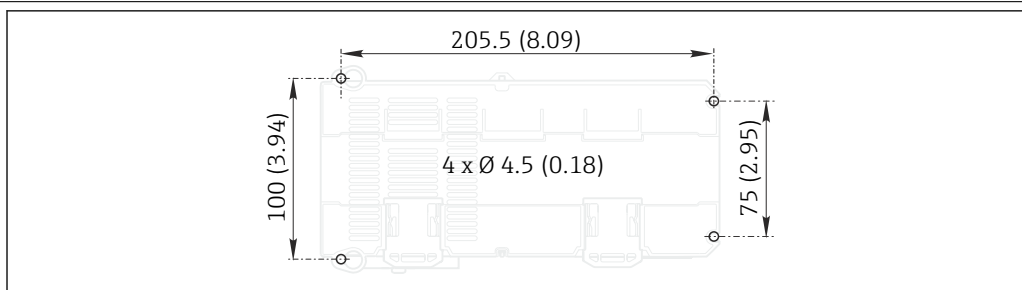


A0027859

32 Drilling pattern for wall mounting in mm (in)

Mounting the external display

 The mounting plate also serves as the drilling template. The marks on the side help you mark the position of the drill holes.

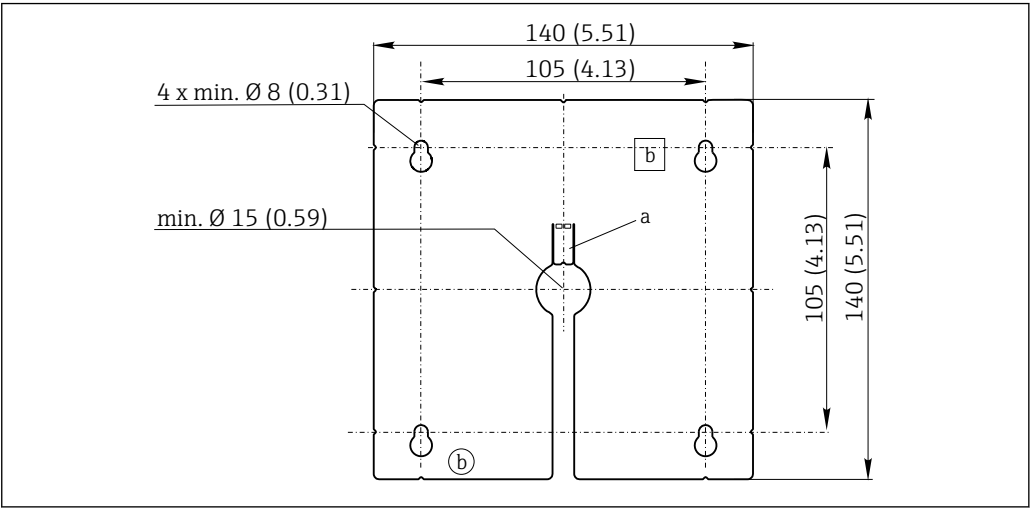

 33 Mounting plate of external display, dimensions in mm (in)

- a Retaining tab
b Production-related recesses, no function for the user

Environment

Ambient temperature

- Cabinet device**
- Generally 0 to 50 °C (32 to 120 °F), with the exception of packages under the following point in the list
 - 0 to 45 °C (32 to 110 °F) for the following packages:
CM44P-**DINP2M4*A5FI*****+...

External display (optional)
-20 to 60 °C (0 to 140 °F)

- Field device**
- Generally -20 to 50 °C (0 to 120 °F), with the exception of packages under the following point in the list
 - -20 to 45 °C (0 to 110 °F) for the following packages:
CM44P-**FIHP2M4*A5FI*****+...

Storage temperature

Cabinet device
-25 to 85 °C (-13 to 185 °F)

Field device
-40 to +80 °C (-40 to 175 °F)

Relative humidity

Cabinet device
5 to 85%, not condensing

External display (in installed state)
5 to 95%, not condensing

Field device
10 to 95 %, non-condensating

Degree of protection

Cabinet device
IP20 shock protection

External display

IP66 front-panel, when installed correctly including seal for housing door

Field device

IP 66/67, impermeability and corrosion resistance in accordance with NEMA TYPE 4X

Climate class (cabinet device only)

As per IEC 60654-1: B2

Vibration resistance**Environmental tests**

Vibration test based on DIN EN 60068-2, October 2008

Vibration test based on DIN EN 60654-3, August 1998

Post or pipe mounting

Frequency range 10 to 500 Hz (sinusoidal)

Amplitude 10 to 57.5 Hz: 0.15 mm
57.5 to 500 Hz: 2 g ¹⁾

Test duration 10 frequency cycles/ spatial axis, in 3 spatial axes (1 oct./min)

Wall mounting

Frequency range 10 to 150 Hz (sinusoidal)

Amplitude 10 to 12.9 Hz: 0.75 mm
12.9 to 150 Hz: 0.5 g ¹⁾

Test duration 10 frequency cycles/ spatial axis, in 3 spatial axes (1 oct./min)

1) g ... gravitational acceleration (1 g $\approx$ 9.81 m/s²)**Electromagnetic compatibility**

Interference emission and interference immunity as per EN 61326-1:2013, Class A for Industry

Electrical safety**Cabinet device**

IEC 61010-1, Class I equipment

Low voltage: overvoltage category II

Environment < 2000 m (< 6562 ft) above MSL

Field device

IEC 61010-1, Class I equipment

Low voltage: overvoltage category II

Environment < 3000 m (< 9840 ft) above MSL

Pollution degree**cabinet device**

The product is suitable for pollution degree 2.

Optional display (for cabinet device)

The product is suitable for pollution degree 4.

Field device

The product is suitable for pollution degree 4.

Pressure compensation to environment (field device only)


Filter made of GORE-TEX used as pressure compensation element

Ensures pressure compensation to environment and guarantees IP protection.

Mechanical construction

Dimensions


Field device

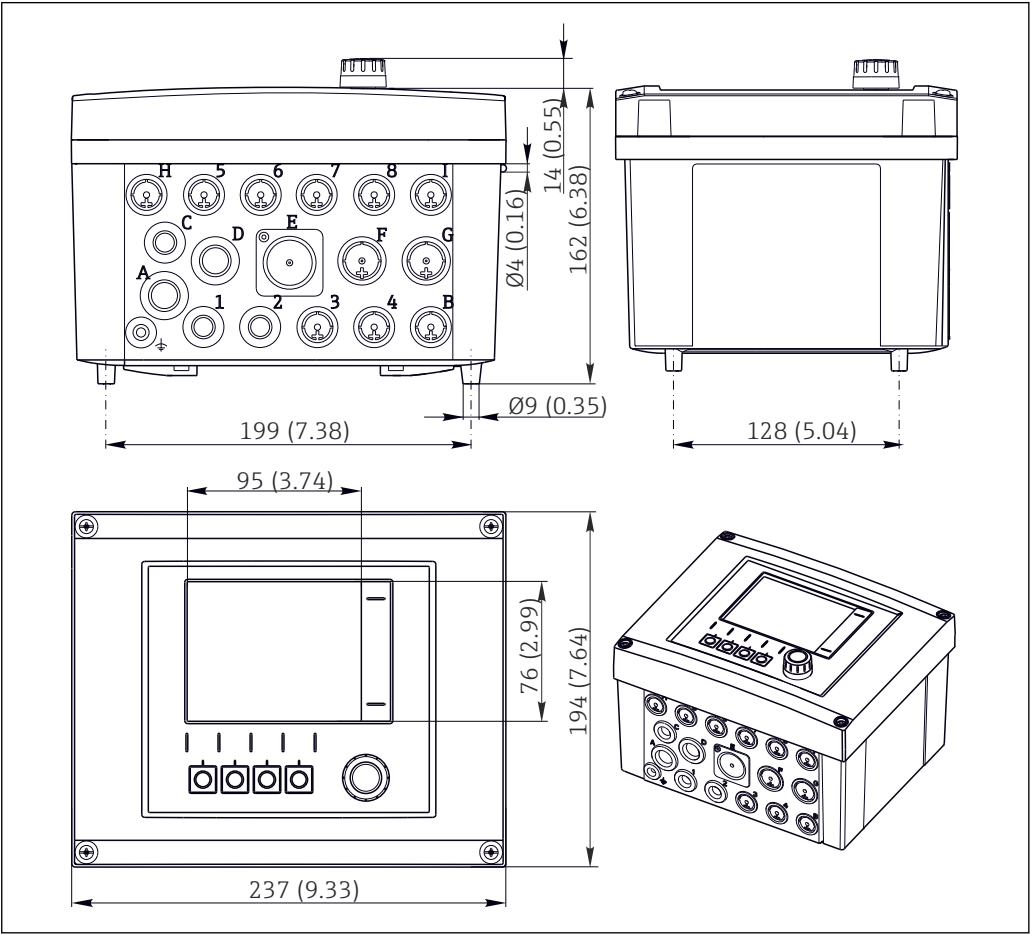

34 Dimensions of field housing in mm (inch)

A0012396


cabinet device

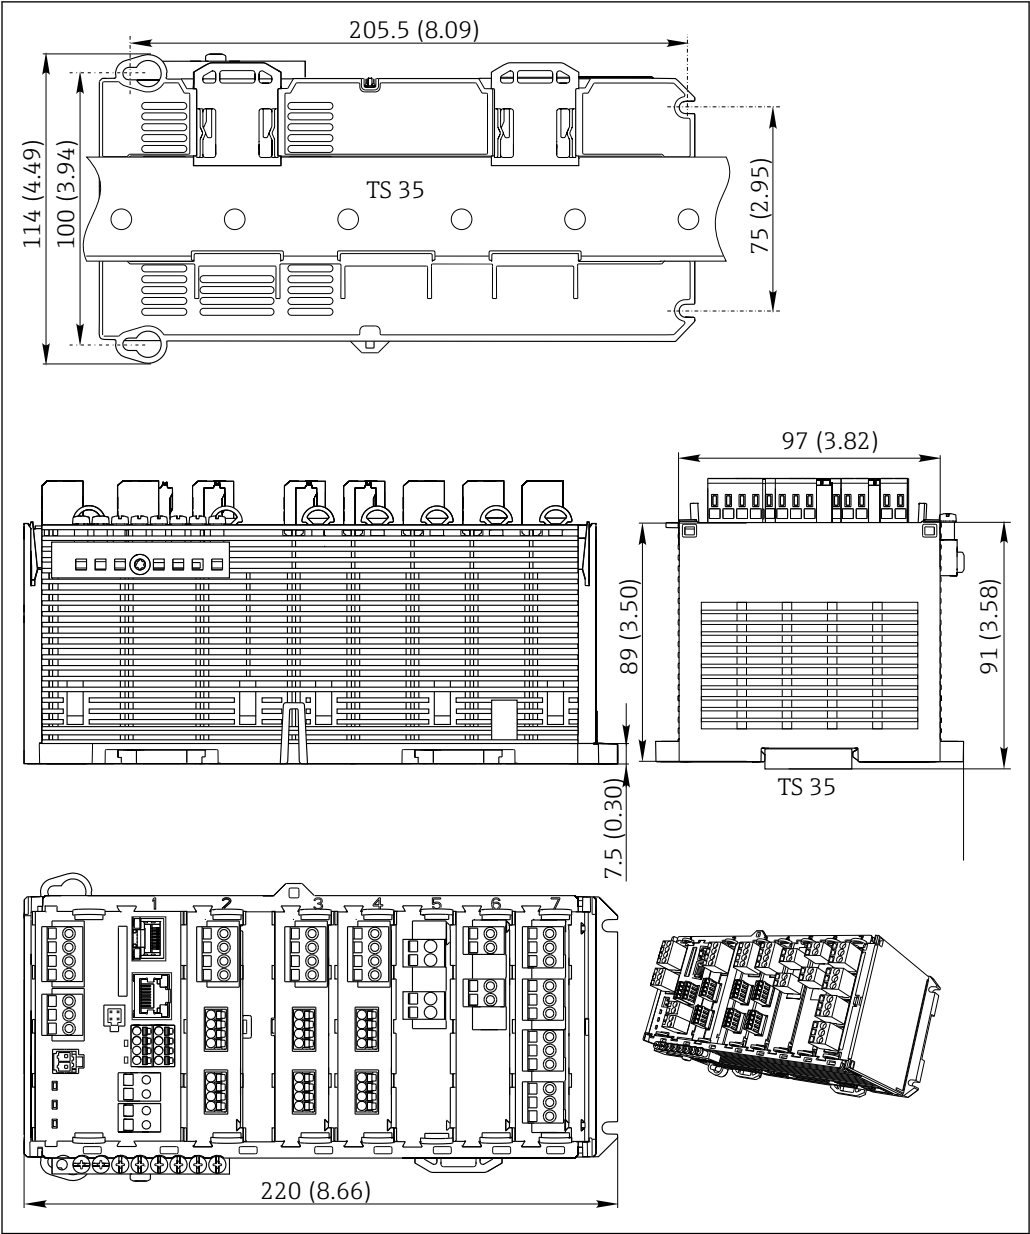

35 Dimensions in mm (inch)

A0039730


Optional display (for cabinet device)

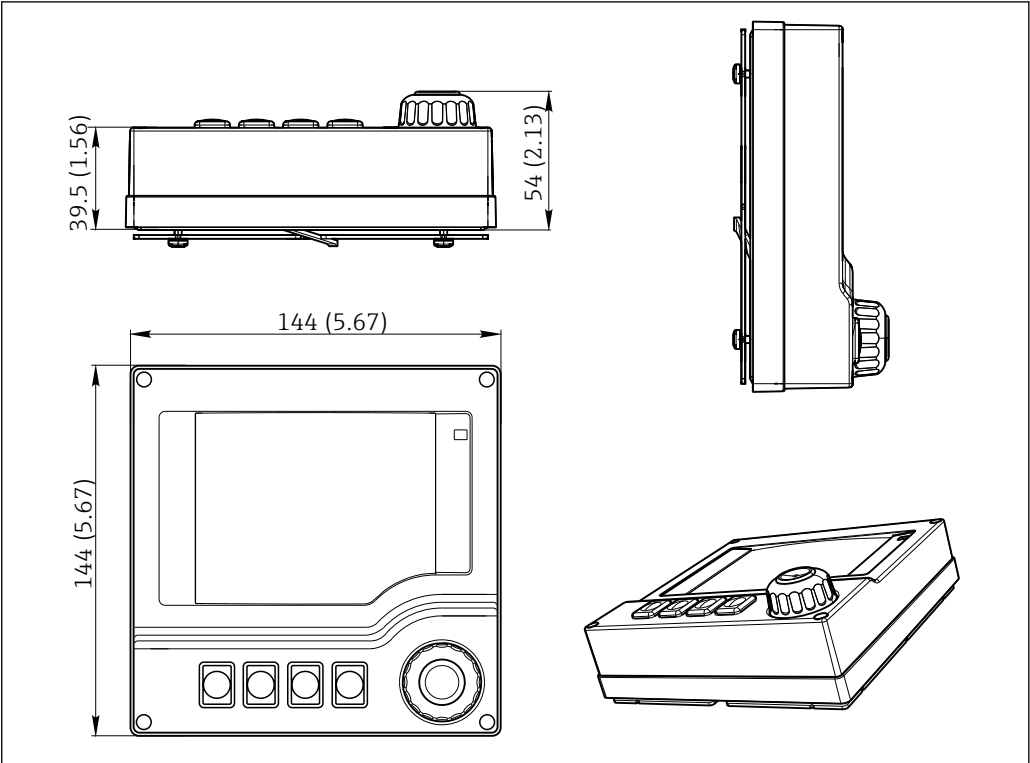


36 Dimensions in mm (inch)

External power units (for cabinet device)


Depending on the version ordered, a power unit for connection to 230 V or 24 V is supplied. There are two delivery variants for each version (cannot be selected). The factory-preferred variant is shown on the left in each case.

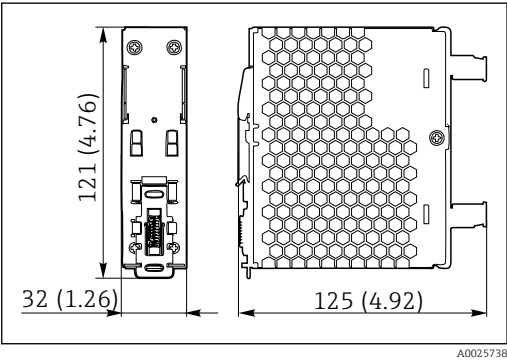


37 Power unit 230 V

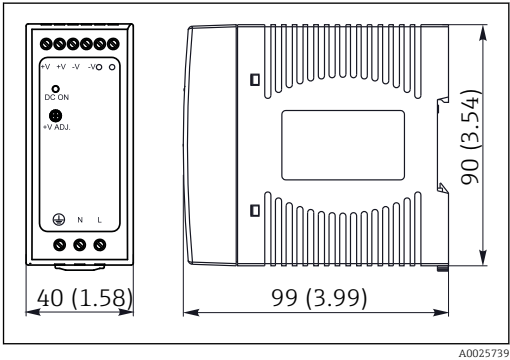

38 Power unit 230 V (optional)

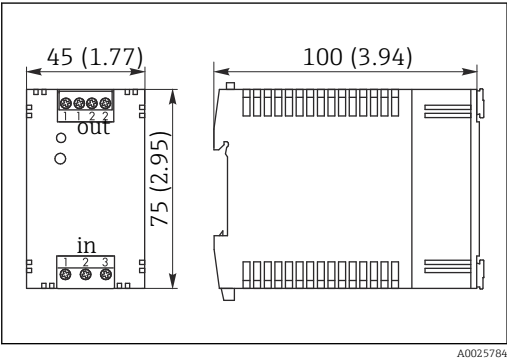

39 Power unit 24 V

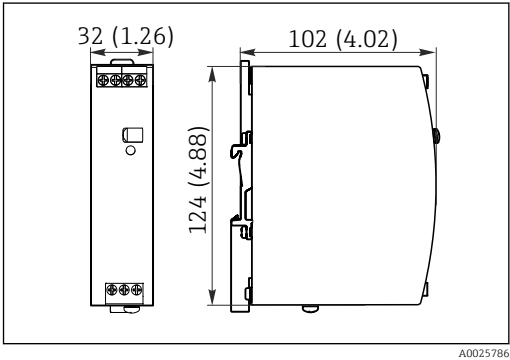


40 Power unit 24 V (optional)

Service display (accessories)

The service display comprises:

- Portable display (same dimensions as under "Optional display")
- Cover to protect the display and to hook it onto the (open) cabinet door

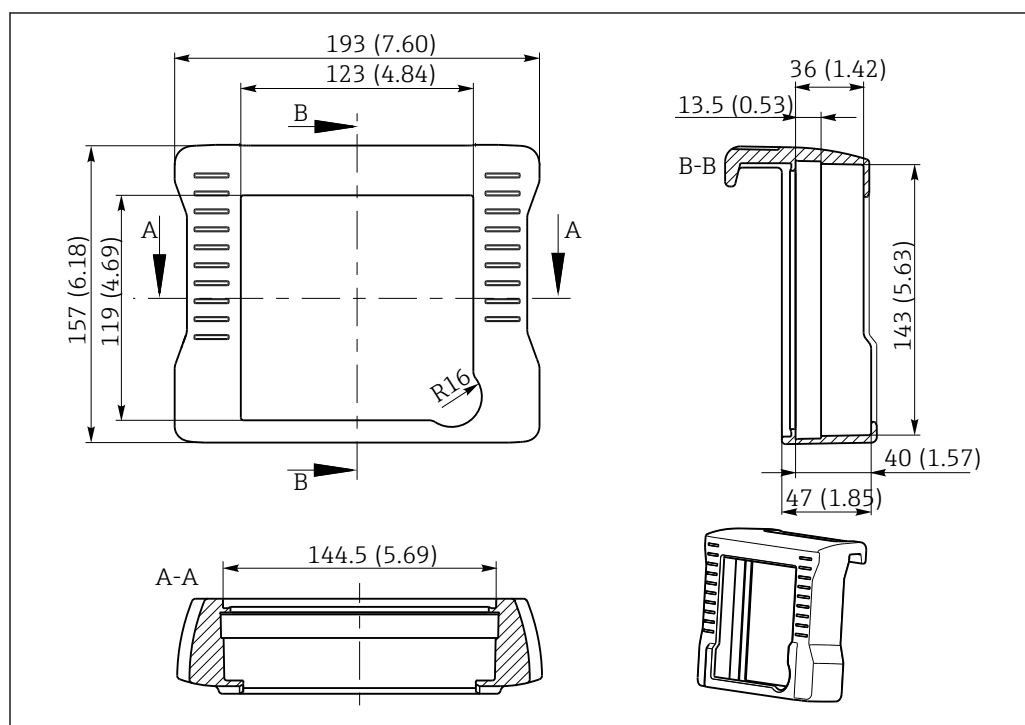

A0025343

41 Dimensions of the service display cover in mm (inch)

Weight	Field device	
	Complete device	Approx. 2.1 kg (4.63 lbs), depending on the version
	Individual module	Approx. 0.06 kg (0.13 lbs)
	Cabinet device	
	CM44P (fully configured)	Approx. 0.95 kg (2.1 lbs)
	Individual module	Approx. 0.06 kg (0.13 lbs)
	External display (excluding cables)	Approx. 0.56 kg (1.2 lbs)
	Service display cover	0.46 kg (1 lbs)
	External power unit	0.27 to 0.42 kg (0.60 to 0.92 lbs), depending on the power unit variant

Materials

Housing base and DIN rail housing	PC-FR
Display cover	PC-FR
Display foil and soft keys (field device)	PE
Housing seal Display seal	EPDM
Soft keys (optional display)	EPDM
Module side panels	PC-FR
Module covers	PBT GF30 FR
Cable mounting rail (field device) Terminal strip (cabinet device)	PBT GF30 FR, stainless steel 1.4301 (AISI304) Nickel-plated brass
Clamps Ground terminals	Stainless steel 1.4301 (AISI304)
Threaded fasteners	Stainless steel 1.4301 (AISI304)
Mounting plate (optional display)	Stainless steel 1.4301 (AISI304)
Securing screws (optional display)	Steel, galvanized
Cover for service display (accessories)	EPDM
Cable glands	Polyamide V0 as per UL94

Operability

display

- Graphic display:
- Resolution: 240 x 160 pixel
 - Back light with switch-off function
 - Red display background for alarms alerts users to errors
 - Transflective display technology for maximum contrast even in bright environments
 - User-definable measuring menus mean you can always keep track of the values that are important for your application.

Operating concept


- The simple and structured operating concept sets new standards:
- Intuitive operation with the navigator and soft keys
 - Fast configuration of application-specific measurement options
 - Easy configuration and diagnosis thanks to plain-text display
 - All languages that can be ordered are available in every device



42 Easy operation

43 Plain-text menu

Local operation

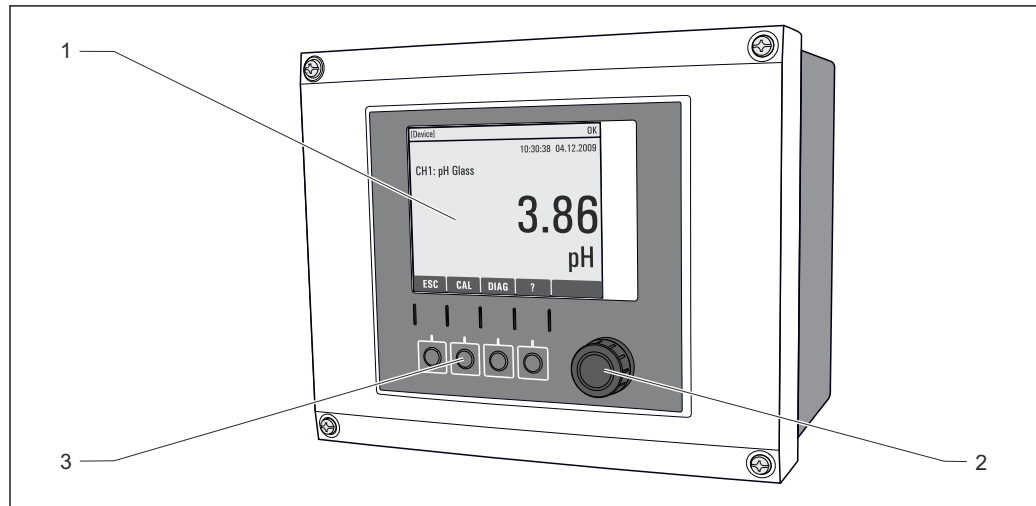


A0011764

44 Overview of operation (using the example of the field device)

- 1 Display (with red display background in alarm condition)
- 2 Navigator (jog/shuttle and press/hold function)
- 3 Soft keys (function depends on menu)

Remote operation

Via HART (e.g. via HART modem and FieldCare)

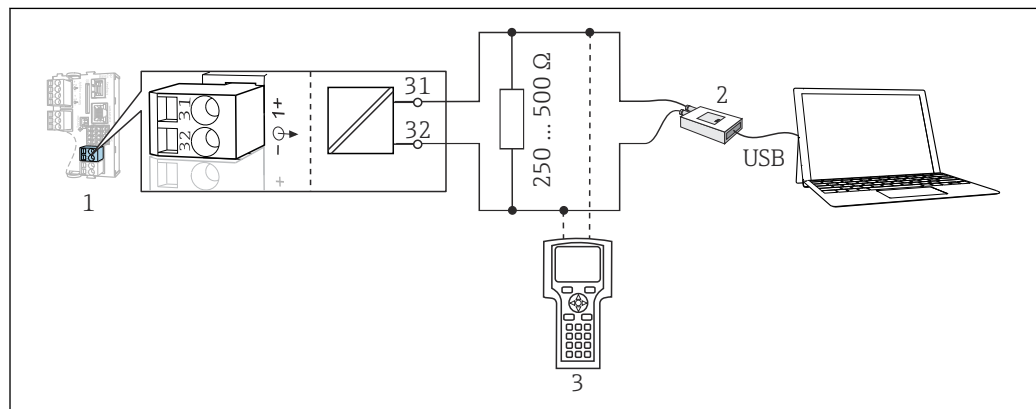


A0039620

45 HART using modem

- 1 Device module Base2-L, -H or -E: current output 1 with HART
- 2 HART modem for connection to PC, e.g. Commubox FXA191 (RS232) or FXA195 ¹⁾ (USB)
- 3 HART handheld terminal


¹⁾ Switch position "on" (substitutes the resistor)

Via PROFIBUS DP

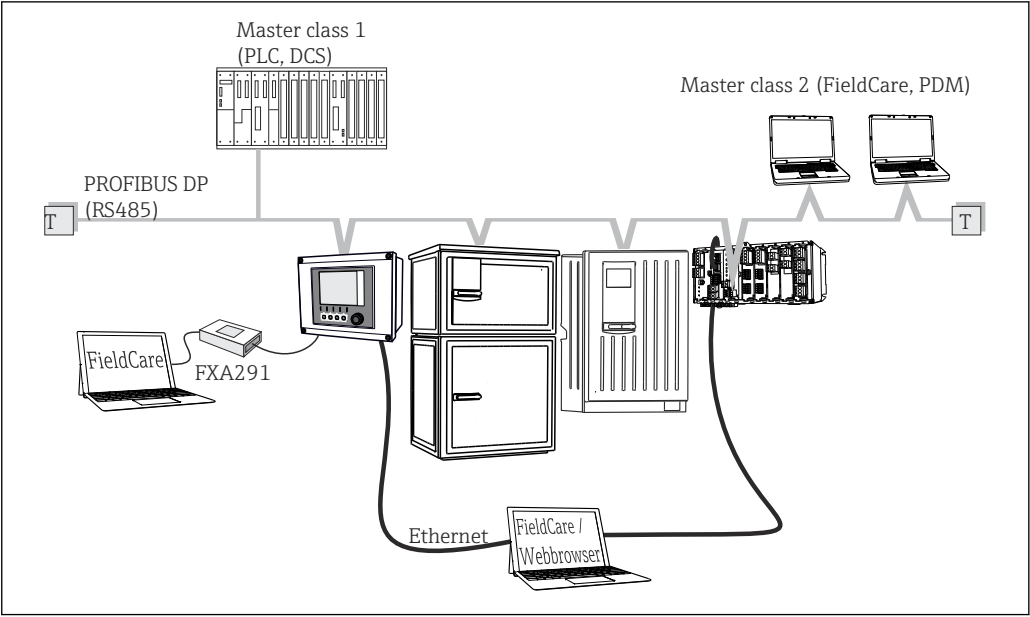


46 PROFIBUS DP
T Terminating resistor

Via Modbus RS485

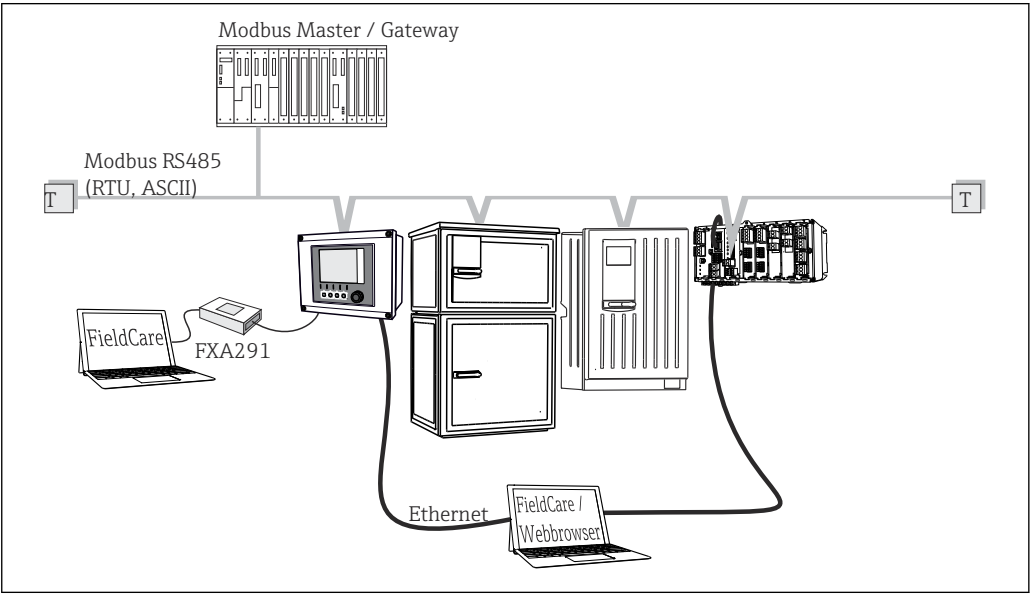

47 Modbus RS485
T Terminating resistor

Via Ethernet: web server/Modbus TCP/PROFINET/EtherNet/IP

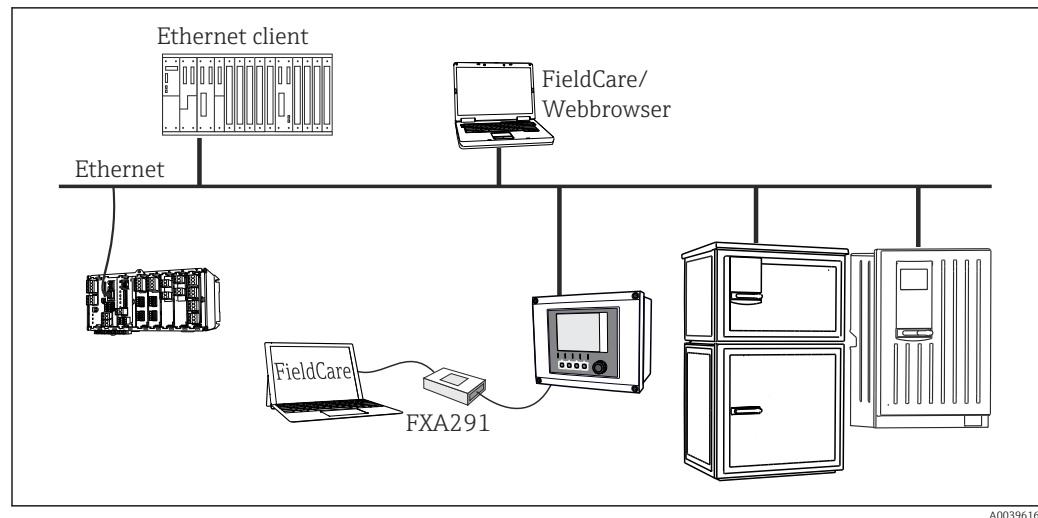

48 Modbus TCP or EtherNet/IP or PROFINET

Language packages

The language selected in the product structure is the operating language preset at the factory. All other languages can be selected using the menu.

- English (US)
- German
- Chinese (Simplified, PR China)
- Czech
- Dutch
- French
- Italian
- Japanese
- Polish
- Portuguese
- Russian
- Spanish
- Swedish
- Turkish
- Hungarian
- Croatian
- Vietnamese

The availability of other languages can be checked via the product structure at www.endress.com/cm44p.

Certificates and approvals

CE mark

The product meets the requirements of the harmonized European standards. As such, it complies with the legal specifications of the EU directives. The manufacturer confirms successful testing of the product by affixing to it the **CE** mark.

cCSAus

The device has been certified with regard to its electrical safety and for Class I Div. 2 cCSAus explosion-proof environments. It meets the requirements in accordance with:

- CLASS 2252 06 - Process Control Equipment
- CLASS 2252 86 - Process Control Equipment - Certified to US Standards
- CLASS 2258 03 - Process Control Equipment - Intrinsically Safe and Non-incendive Systems - For Hazardous Locations
- CLASS 2258 83 - Process Control Equipment - Intrinsically Safe and Non-incendive Systems - For Hazardous Locations - Certified to US Standards
- FM3600
- FM3611
- FM3810

- UL50E
- IEC 60529
- CAN/CSA-C22.2 No. 0
- CAN/CSA C22.2 No. 94
- CSA Std. C22.2 No. 213
- CAN/CSA-C22.2 No. 61010-1
- CAN/CSA-C22.2 No. 60529
- UL/ANSI/ISA 61010-1
- ANSI - ISA 12 12 01

Marine approvals

A selection of the devices and sensors have type approval for marine applications, issued by the following classification societies: ABS (American Bureau of Shipping), BV (Bureau Veritas), DNV-GL (Det Norske Veritas-Germanischer Lloyd) and LR (Lloyd's Register). Details of the order codes of the approved devices and sensors, and the installation and ambient conditions, are provided in the relevant certificates for marine applications on the product page on the Internet.

ATEX / IECEx approval

Version CM44P-BM

- EN IEC 60079-0:2018
- EN IEC 60079-11:2012
XA02419C

Version CM44P-IE

- EN IEC 60079-0:2017
- EN IEC 60079-11:2011
XA02419C

Ordering information

Product page	www.endress.com/cm44p
Product Configurator	On the product page there is a Configure button to the right of the product image. 1. Click this button. ↳ The Configurator opens in a separate window. 2. Select all the options to configure the device in line with your requirements. ↳ In this way, you receive a valid and complete order code for the device. 3. Export the order code as a PDF or Excel file. To do so, click the appropriate button on the right above the selection window.  For many products you also have the option of downloading CAD or 2D drawings of the selected product version. Click the CAD tab for this and select the desired file type using picklists.
Scope of delivery	The scope of delivery comprises: ■ 1 multichannel controller in the version ordered ■ 1 mounting plate ■ 1 wiring label (attached at the factory to the inside of the display cover) ■ 1 external display (if selected as an option) ²⁾ ■ 1 DIN rail power unit incl. cable (cabinet device only) ■ 1 printed copy of the Operating Instructions for the DIN rail power unit (cabinet device only) ■ 1 printed copy of the Brief Operating Instructions in the language ordered ■ Disconnection element (pre-installed on hazardous area version type 2DS Ex-i) ■ Safety instructions for the hazardous area (for hazardous area version type 2DS Ex-i)

Accessories

The following are the most important accessories available at the time this documentation was issued.

- For accessories not listed here, please contact your Service or Sales Center.

Device-specific accessories	Measuring cable CUK80 cable set ■ Pre-terminated and labeled cables for connecting analog photometer sensors ■ Product Configurator on the product page: www.endress.com/cuk80 Memosens data cable CYK10 ■ For digital sensors with Memosens technology ■ Product Configurator on the product page: www.endress.com/cyk10  Technical Information TI00118C Memosens data cable CYK11 ■ Extension cable for digital sensors with Memosens protocol ■ Product Configurator on the product page: www.endress.com/cyk11  Technical Information TI00118C
------------------------------------	--

2) The external display can be selected as an option in the order structure or ordered as an accessory at a later stage.

Sensors

Photometer sensors

OUSAF11

- Optical sensor for VIS/NIR absorption
- Stainless steel housing and sensor head made from dirt-repellent FEP
- Product Configurator on the product page: www.endress.com/ousaf11



Technical Information TI00474C

OUSAF12

- Optical sensor for the measurement of absorbance
- Variety of materials and process connections available
- Product Configurator on the product page: www.endress.com/ousaf12



Technical Information TI00497C

OUSAF22

- Optical sensor for measuring color concentrations
- Variety of materials and process connections available
- Product Configurator on the product page: www.endress.com/ousaf22



Technical Information TI00472C

OUSAF44

- Optical sensor for measuring UV absorption
- Variety of materials and process connections available
- Hygienic design
- Product Configurator on the product page: www.endress.com/ousaf44



Technical Information TI00416C

OUSTF10

- Optical sensor for measuring turbidity and undissolved solids
- Variety of materials and process connections available
- Product Configurator on the product page: www.endress.com/oustf10



Technical Information TI00500C

OUSBT66

- NIR absorption sensor for measuring cell growth and biomass
- Sensor version suitable for pharmaceutical industry
- Product Configurator on the product page: www.endress.com/ousbt66



Technical Information TI00469C

Glass electrodes

Memosens CPS11E

- pH sensor for standard applications in process and environmental engineering
- Digital with Memosens 2.0 technology
- Product Configurator on the product page: www.endress.com/cps11e



Technical Information TI01493C

Memosens CPS41E

- pH sensor for process technology
- With ceramic junction and KCl liquid electrolyte
- Digital with Memosens 2.0 technology
- Product Configurator on the product page: www.endress.com/cps41e



Technical Information TI01495C

Memosens CPS71E

- pH sensor for chemical process applications
- With ion trap for poison-resistant reference
- Digital with Memosens 2.0 technology
- Product Configurator on the product page: www.endress.com/cps71e



Technical Information TI01496C

Memosens CPS91E

- pH sensor for heavily polluted media
- With open aperture
- Digital with Memosens 2.0 technology
- Product Configurator on the product page: www.endress.com/cps91e



Technical Information TI01497C

Orbisint CPS11D

- pH sensor for process technology
- With dirt-repellent PTFE diaphragm
- Product Configurator on the product page: www.endress.com/cps11d



Technical Information TI00028C

Memosens CPS31D

- pH electrode with gel-filled reference system with ceramic diaphragm
- Product Configurator on the product page: www.endress.com/cps31d



Technical Information TI00030C

Ceraliquid CPS41D

- pH electrode with ceramic junction and KCl liquid electrolyte
- Product Configurator on the product page: www.endress.com/cps41d



Technical Information TI00079C

Ceragel CPS71D

- pH electrode with reference system including ion trap
- Product Configurator on the product page: www.endress.com/cps71d



Technical Information TI00245C

Memosens CPS171D

- pH electrode for bio-fermenters with digital Memosens technology
- Product Configurator on the product page: www.endress.com/cps171d



Technical Information TI01254C

Orbipore CPS91D

- pH electrode with open aperture for media with high dirt load
- Product Configurator on the product page: www.endress.com/cps91d



Technical Information TI00375C

Orbipac CPF81D

- Compact pH sensor for installation or immersion operation
- In industrial water and wastewater
- Product Configurator on the product page: www.endress.com/cpf81d



Technical Information TI00191C

*Enamel pH electrodes***Ceramax CPS341D**

- pH electrode with pH-sensitive enamel
- Meets highest demands of measuring accuracy, pressure, temperature, sterility and durability
- Product Configurator on the product page: www.endress.com/cps341d



Technical Information TI00468C

ORP sensors

Memosens CPS12E

- ORP sensor for standard applications in process and environmental engineering
- Digital with Memosens 2.0 technology
- Product Configurator on the product page: www.endress.com/cps12e



Technical Information TI01494C

Orbisint CPS12D

- ORP sensor for process technology
- Product Configurator on the product page: www.endress.com/cps12d



Technical Information TI00367C

Ceraliquid CPS42D

- ORP electrode with ceramic junction and KCl liquid electrolyte
- Product Configurator on the product page: www.endress.com/cps42d



Technical Information TI00373C

Ceragel CPS72D

- ORP electrode with reference system including ion trap
- Product Configurator on the product page: www.endress.com/cps72d



Technical Information TI00374C

Orbipac CPF82D

- Compact ORP sensor for installation or immersion operation in process water and wastewater
- Product Configurator on the product page: www.endress.com/cpf82d



Technical Information TI00191C

Orbipore CPS92D

- ORP electrode with open aperture for media with high dirt load
- Product Configurator on the product page: www.endress.com/cps92d



Technical Information TI00435C

pH-ISFET sensors

Memosens CPS47D

- Sterilizable and autoclavable ISFET sensor for pH measurement
- Refillable KCl liquid electrolyte
- Product Configurator on the product page: www.endress.com/cps47d



Technical Information TI01412C

Memosens CPS77D

- Sterilizable and autoclavable ISFET sensor for pH measurement
- Product Configurator on the product page: www.endress.com/cps77d



Technical Information TI01396

Memosens CPS97D

- ISFET sensor for pH measurement with long-term stability in media with high dirt loads
- Product Configurator on the product page: www.endress.com/cps97d



Technical Information TI01405C

Combined pH/ORP sensors

Memosens CPS16D

- Combined pH/ORP sensor for process technology
- With dirt-repellent PTFE diaphragm
- With Memosens technology
- Product Configurator on the product page: www.endress.com/cps16D



Technical Information TI00503C

Memosens CPS76D

- Combined pH/ORP sensor for process technology
- Hygienic and sterile applications
- With Memosens technology
- Product Configurator on the product page: www.endress.com/cps76d



Technical Information TI00506C

Memosens CPS96D

- Combined pH/ORP sensor for chemical processes
- With poison-resistant reference with ion trap
- With Memosens technology
- Product Configurator on the product page: www.endress.com/cps96d



Technical Information TI00507C

*Conductivity sensors with inductive measurement of conductivity***Indumax CLS50D**

- High-durability inductive conductivity sensor
- For standard and hazardous area applications
- With Memosens technology
- Product Configurator on the product page: www.endress.com/cls50d



Technical Information TI00182C

Indumax H CLS54D

- Inductive conductivity sensor
- With certified, hygienic design for foodstuffs, beverages, pharmaceuticals and biotechnology
- Product Configurator on the product page: www.endress.com/cls54d



Technical Information TI00508C

*Conductivity sensors with conductive measurement of conductivity***Condumax CLS15D**

- Conductive conductivity sensor
- For pure water, ultrapure water and hazardous area applications
- Product Configurator on the product page: www.endress.com/CLS15d



Technical Information TI00109C

Condumax CLS16D

- Hygienic, conductive conductivity sensor
- For pure water, ultrapure water and Ex applications
- With EHEDG and 3A approval
- Product Configurator on the product page: www.endress.com/CLS16d



Technical Information TI00227C

Condumax CLS21D

- Two-electrode sensor in plug-in head version version
- Product Configurator on the product page: www.endress.com/CLS21d



Technical Information TI00085C

Memosens CLS82D

- Four-electrode sensor
- With Memosens technology
- Product Configurator on the product page: www.endress.com/cls82d



Technical Information TI01188C

Oxygen sensors

Oxymax COS22D

- Sterilizable sensor for dissolved oxygen
- With Memosens technology
- Product Configurator on the product page: www.endress.com/cos22d



Technical Information TI00446C

Oxymax COS51D

- Amperometric sensor for dissolved oxygen
- With Memosens technology
- Product Configurator on the product page: www.endress.com/cos51d



Technical Information TI00413C

Oxymax COS61D

- Optical oxygen sensor for drinking water and industrial water measurement
- Measuring principle: quenching
- With Memosens technology
- Product Configurator on the product page: www.endress.com/cos61d



Technical Information TI00387C

Memosens COS81D

- Sterilizable, optical sensor for dissolved oxygen
- With Memosens technology
- Product Configurator on the product page: www.endress.com/cos81d



Technical Information TI01201C

Disinfection sensors

CCS142D

- Membrane-covered amperometric sensor for free chlorine
- Measuring range 0.01 to 20 mg/l
- With Memosens technology
- Product Configurator on the product page: www.endress.com/ccs142d



Technical Information TI00419C

Ion-selective sensors

ISEmax CAS40D

- Ion selective sensors
- Product Configurator on the product page: www.endress.com/cas40d



Technical Information TI00491C

Turbidity sensors

Turbimax CUS51D

- For nephelometric measurements of turbidity and solids in wastewater
- 4-beam scattered light method
- With Memosens technology
- Product Configurator on the product page: www.endress.com/cus51d



Technical Information TI00461C

Turbimax CUS52D

- Hygienic Memosens sensor for turbidity measurement in drinking water, process water and in utilities
- With Memosens technology
- Product Configurator on the product page: www.endress.com/cus52d



Technical Information TI01136C

*SAC and nitrate sensors***Viomax CAS51D**

- SAC and nitrate measurement in drinking water and wastewater
- With Memosens technology
- Product Configurator on the product page: www.endress.com/cas51d



Technical Information TI00459C

*Interface measurement***Turbimax CUS71D**

- Immersion sensor for interface measurement
- Ultrasonic interface sensor
- Product Configurator on the product page: www.endress.com/cus71d



Technical Information TI00490C

Communication-specific accessories**Device Care SFE100**

- Configuration of Endress+Hauser devices
- Fast and easy installation, online application updates, one-click connection to devices
- Automatic hardware identification and driver catalog update
- Device configuration with DTMs



Technical Information Device Care SFE100, TI01134S

Commubox FXA195

Intrinsically safe HART communication with FieldCare via the USB port



Technical Information TI00404F

Commubox FXA291

Connects the CDI interface of measuring devices with the USB port of the computer or laptop



Technical Information TI00405C

Wireless HART adapter SWA70

- Wireless device connection
- Easily integrated, offers data protection and transmission safety, can be operated in parallel with other wireless networks, minimum cabling complexity



Technical Information TI00061S

Field Data Manager Software MS20/21

- PC software for central data management
- Visualization of series of measurements and logbook events
- SQL database for secure data storage

FieldCare SFE500

- Universal tool for field device configuration and management
- Supplied with a complete library of certified DTMs (Device Type Manager) for operation of Endress+Hauser field devices
- Order according to product order structure
- www.endress.com/sfe500

Memobase Plus CYZ71D

- PC software to support laboratory calibration
- Visualization and documentation of sensor management
- Sensor calibrations stored in database
- Product Configurator on the product page: www.endress.com/cyz71d



Technical Information TI00502C

Service-specific accessories

Additional functionality

Hardware extension modules

Kit, extension module AOR

- 2 x relay, 2 x 0/4 to 20 mA analog output
- Order No. 71111053

Kit, extension module 2R

- 2 x relay
- Order No. 71125375

Kit, extension module 4R

- 4 x relay
- Order No. 71125376

Kit, extension module 2AO

- 2 x 0/4 to 20 mA analog output
- Order No. 71135632

Kit, extension module 4AO

- 4 x analog output 0/4 to 20 mA
- Order No. 71135633

Kit, extension module 2DS

- 2 x digital sensor, Memosens
- Order No. 71135631

Kit, extension module 2AI

- 2 x 0/4 to 20 mA analog input
- Order No. 71135639

Kit, extension module DIO

- 2 x digital input
- 2 x digital output
- Auxiliary voltage supply for digital output
- Order No. 71135638

Kit, extension module 485

- Can be extended to PROFIBUS DP or Modbus RS485. This requires an additional activation code which can be ordered separately.
- Order No. 71135634

Upgrade kit, extension module 485 with PROFIBUS DP

- Extension module 485
- PROFIBUS DP (+ Ethernet configuration)
- Order No. 71140888

Upgrade kit, extension module 485 with Modbus RS485

- Extension module 485
- Modbus RS485 (+ Ethernet configuration)
- Order No. 71140889

Firmware and activation codes

SD card with Liquiline firmware

- Industrial Flash Drive, 1 GB
- Order No. 71127100



You must quote the serial number of the device when ordering the activation code.

Activation code for digital HART communication

Order No. 71128428

Activation code for PROFIBUS DP

Order No. 71135635

Activation code for Modbus RS485

Order No. 71135636

Activation code for PROFINET + web server for BASE2

Order No. 71449901

Activation code for Ethernet/IP + web server for BASE2

Order No. 71449914

Activation code for Modbus TCP + web server for BASE2

Order No. 71449915

Activation code for web server for BASE2

Order No. 71449918

Kit CM442: activation code for 2nd digital sensor input

Order No. 71114663

Kit CM444/CM448: upgrade code for 2 x 0/4 to 20 mA for BASE2-E

On request

Activation code for feedforward control

- Requires current input or fieldbus communication
- Order No. 71211288

Activation code for measuring range switch

- Requires digital inputs or fieldbus communication
- Order No. 71211289

Activation code for ChemocleanPlus

- Requires relays or digital outputs or fieldbus communication and optional digital inputs
- Order No. 71239104

Activation code for Heartbeat Verification and Monitoring

Order No. 71367524

Activation code for ion exchanger operating time

- Configure the mathematical function
- Order No. 71367531

Activation code for mathematics

- Formula editor
- Order No. 71367541

System components**RIA14, RIA16**

- Field display unit for integration into 4-20 mA circuits
- RIA14 in flameproof metal enclosure



Technical Information TI00143R and TI00144R

RIA15

- Process display unit, Digital display unit for integration into 4-20 mA circuits
- Panel mounting
- With optional HART communication



Technical Information TI01043K

Other accessories**External display³⁾****Graphic display**

- For installation in the control cabinet door or panel
- Order No. 71185295

Service display

- Portable, for commissioning
- Order No. 71185296

SD card

- Industrial Flash Drive, 1 GB
- Order No. 71110815

M12 built-in socket and cable junction with Velcro strip**Kit CM42/CM442/CM444/CM448: external CDI socket**

- Socket with terminated connecting cables and counter nut
- Order No. 51517507

3) The external display can be selected as an option in the product structure or ordered subsequently as an accessory.

Kit CM442/CM444/CM448/CSF48: M12 built-in socket for digital sensors

- Pre-terminated
- Order No. 71107456

Kit CM442/CM444/CM448/CSF48: M12 built-in socket for PROFIBUS DP/Modbus RS485

- B-coded, pre-terminated
- Order No. 71140892

Kit CM442/CM444/CM448/CSF48: M12 built-in socket for Ethernet

- D-coded, pre-terminated
- Order No. 71140893

Kit: external CDI socket, complete

- Retrofit kit for CDI interface, with terminated connecting cables
- Order No. 51517507

Cable junction with Velcro strip

- 4 pieces, for sensor cable
- Order No. 71092051



71560284

www.addresses.endress.com
